


FOR LINDE PACK CONTROLLER (SEE NOTE 5)

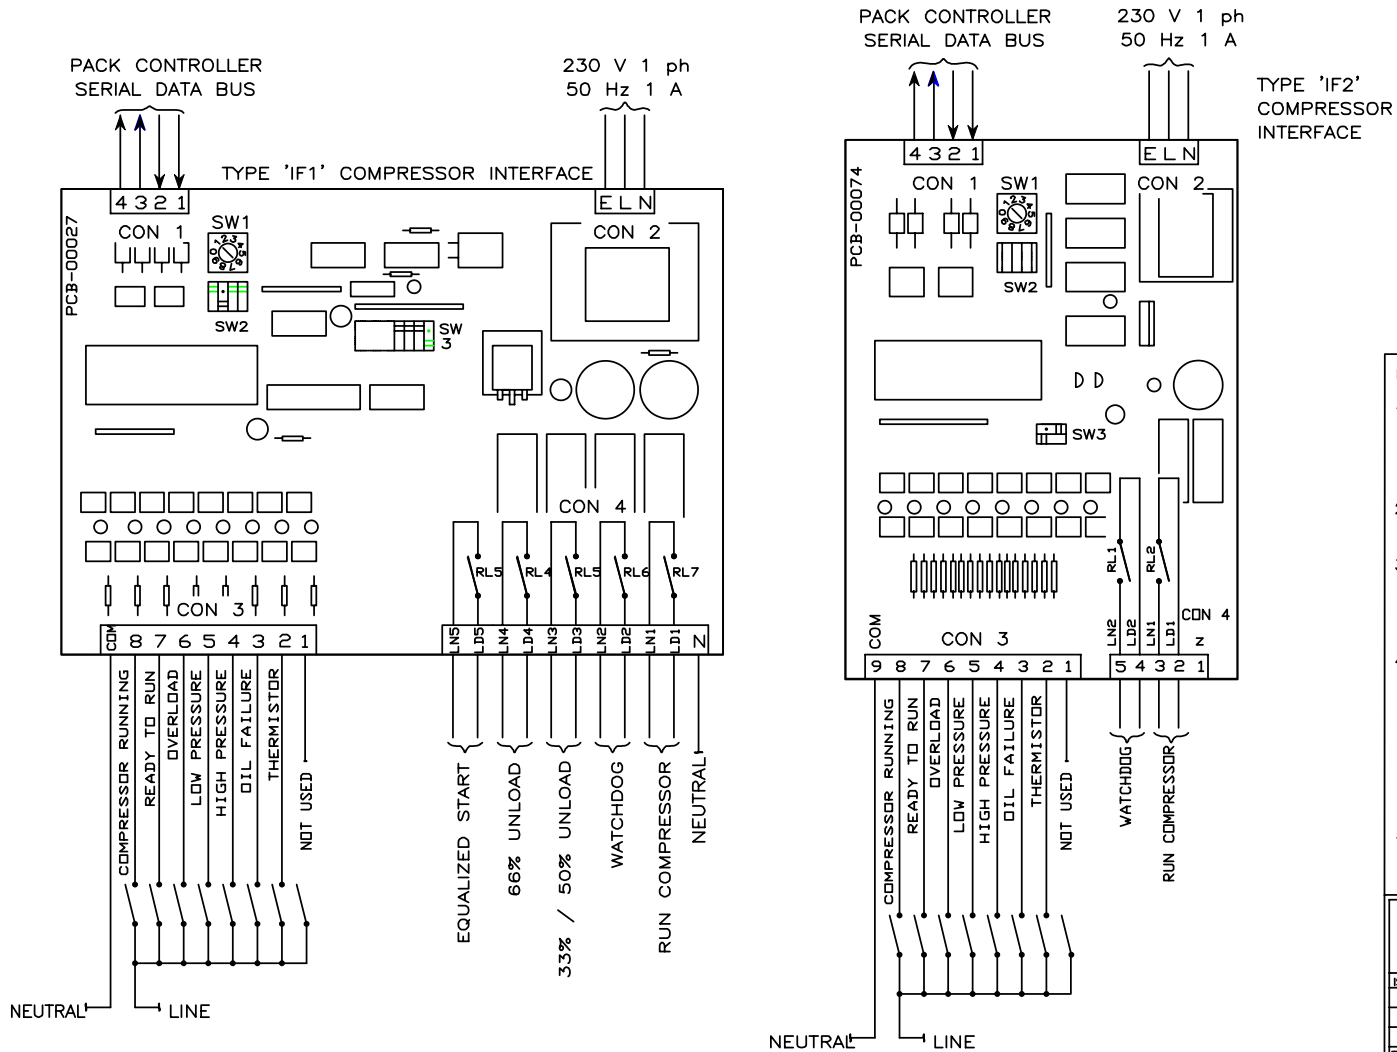

- NOTES
1. INPUT STATES AS FOLLOWS:-
 CLOSED CONTACT = RUNNING READY or FAULT
 OPEN CONTACT = NOT RUNNING, NOT READY or NO FAULT
 2. CON3 TERMINAL 9 **MUST HAVE** NEUTRAL CONNECTED TO IT.
 3. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY, CONNECT LINE VOLTAGES TO TERMINALS PREFIXED 'LN' AND THE CORRESPONDING LOADS TO TERMINALS PREFIXED 'LD'.
 4. **SWITCH SETTINGS**
 THE POSITION OF THE DIP SWITCHES 'SW2' MUST BE SET AS SHOWN (IE: DOT SHOWING CLOSED CONTACT ON SECOND FROM LEFT) FOR THE CARD TO OPERATE CORRECTLY.
 SWITCHES 'SW3' CONTROL THE OUTPUT RELAYS IF PACK SERIAL DATA BUS COMMUNICATIONS FAIL. (CLOSED 'DOT' SHOWING = RELAY ENERGISED).
 5. FOR PACK CONTROLLER TYPES CPLR, CPLS, CP4L, CP5H & EP6U WHEN ITEM 169 SET TO CPNL

JTL SYSTEMS LTD.
 41, KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE. RG14 5SJ
 TEL: 01635-263646 FAX: 01635-263647

ISSUE	DESCRIPTION	APP'D DATE
3	ADDED NOTE 5	MJK 2/99
2	ADDED CPLS & CP4L	MJK 10/98
4	ADDED NEW PRODUCT EP6U	MJK 4/02

TITLE:
COMPRESSOR INTERFACE WIRING

TYPE: IF-1, IF-2

PROJ.	DRG No.	SHT	OF	ISS.
CP	00363	1	1	4

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP