


Application Drawing for Group Defrost Interface (non-scroll Pack Controllers)

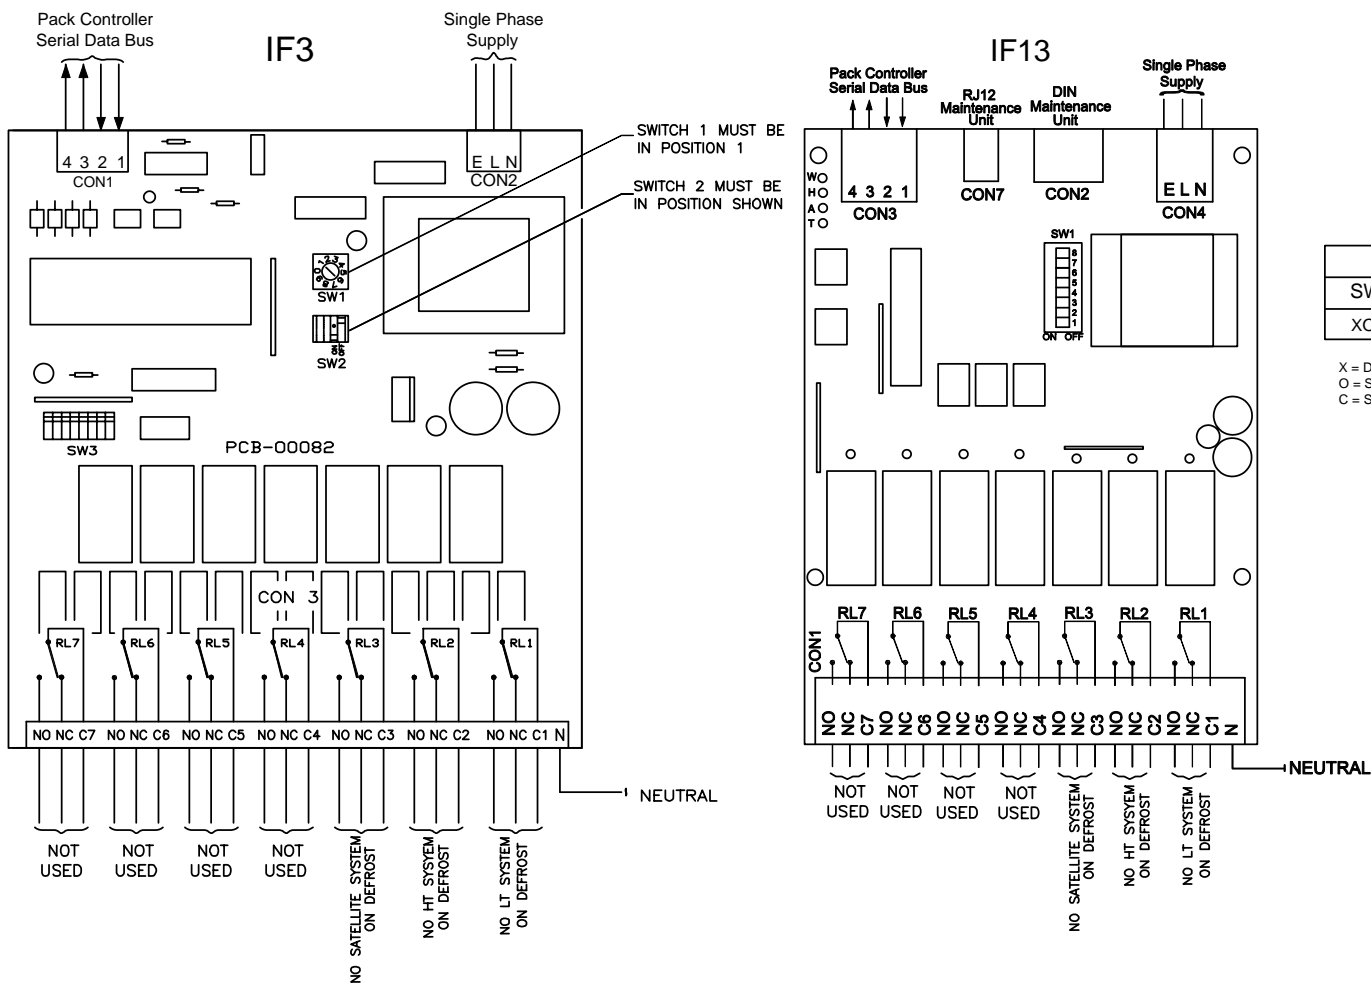

CONFIGURATION

| IF3 | | IF13 | |
|------|-----|---------------------------|-------------------------|
| SW2 | SW1 | INTERFACE TYPE ITEM 31 | INTERFACE NO ITEM 30 |
| XOCO | 1 | 5 | 1 |

X = Don't care
 O = Switch open (off)
 C = Switch closed (on)

NOTES

1. CONTACTS SHOWN IN DE-ENERGISED INDICATING - SYSTEMS ON DEFROST
2. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY. CONNECT LINE VOLTAGES TO TERMINALS PREFIXED 'C' (COMMON) AND THE CORRESPONDING LOADS TO TERMINALS 'NO' & 'NC'.
3. SWITCH SETTINGS
 SWITCHES 'SW3' (SW1 ON IF13) CONTROL THE OUTPUT RELAYS IF PACK SERIAL DATA BUS COMMUNICATIONS FAIL. SWITCH CLOSED (ON) = RELAY ENERGISED.
4. A JTL MAINTENANCE UNIT IS REQUIRED TO CONFIGURE AN IF13.

JTL JTL SYSTEMS LTD.
 41, KINGFISHER COURT, HAMBURIDGE RD,
 NEWBURY, BERKSHIRE. RG14 5SJ
 TEL: 01635-263646 FAX: 01635-263647

| ISS | DESCRIPTION | APP'D | DATE |
|-----|------------------------|-------|-------|
| 3 | ADDED NEW BOARD IF13 | MJK | 07/02 |
| 2 | ADDED NEW PRODUCT EPxx | MJK | 04/02 |
| 1 | ORIGINAL ISSUE | MJK | 7/97 |

TITLE: GROUP DEFROST INTERFACE WIRING
 (FOR NON SCROLL PACK CONTROLLERS)

TYPE: IF3/IF13

| PROJ | DRG No | SHT | OF | ISS. |
|-------|--------|-----|----|------|
| CP/EP | 02023 | 1 | 1 | 3 |

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP