


LOGALERT SYSTEM WIRING 3

TEMPERATURE MONITORING OF FOOD PRIOR TO REFRIGERATION STORAGE

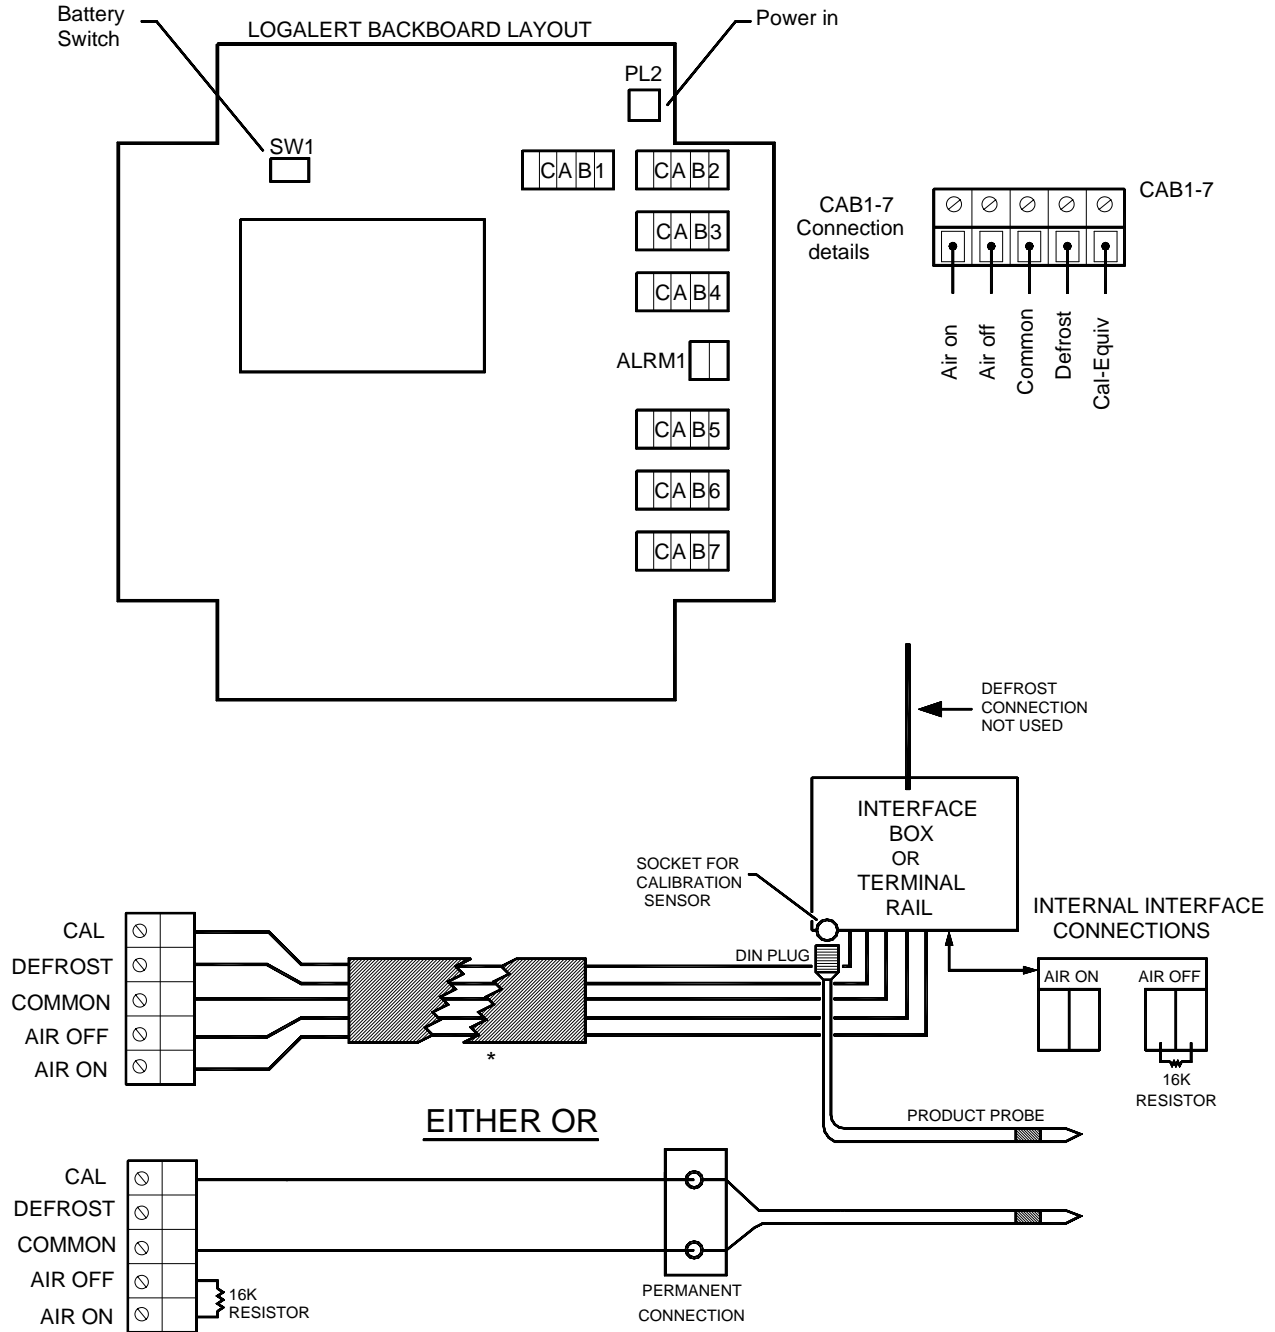

***NOTE:** TO MAINTAIN EMC INTEGRITY MULTICORE MULTISTRAND CABLES MUST BE USED.
SINGLE CORE & SOLIDCORE CABLES ARE NOT ALLOWED.

ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	5/98



JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE. RG14 5SJ
 TEL: 01635-47585 FAX: 01635 31888

TITLE: LOGALERT SYSTEM WIRING 3

TYPE: LOGALERT		SHT	OF	ISS
PROJ:	DRG No:	1	1	1
02229				