


# Application Drawing for Monitoring Waitrose Coldstore "Man trapped" and "Gas Leak" Alarms Using PA410

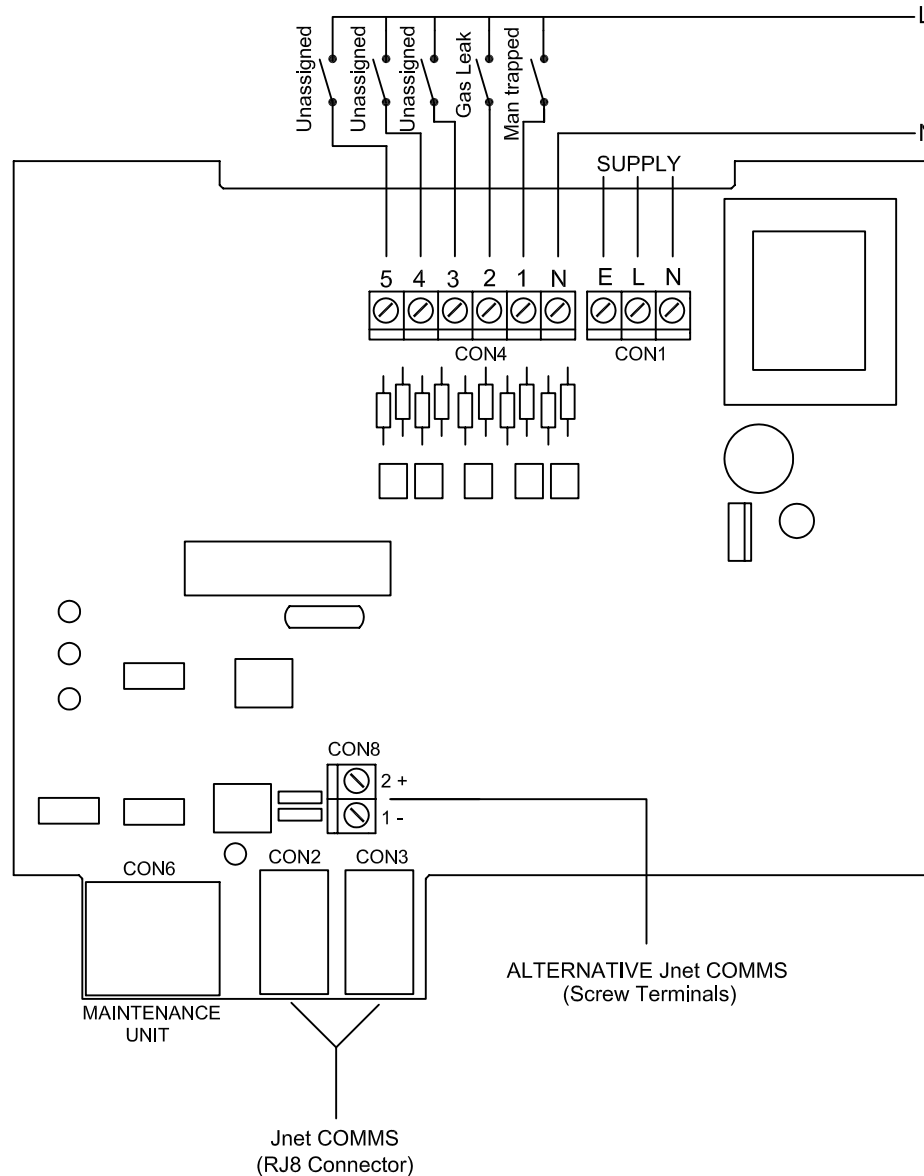

**NOTES:**

1. Unless specified differently supply is 230V ac mains and inputs are 230V ac mains digital. 110V ac and 24V ac options are available.
2. This unit is NOT suitable for 415v use.
3. Input Line voltage should be connected to the numbered terminals and the neutral to the terminal marked N (common neutral).
4. Where a 24v ac supply is used 24v corresponds to the L (Live) terminal and the 0v corresponds to the N (Neutral) terminal.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP



JTL SYSTEMS LTD  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
1	NOTE 2 CHANGED	MJK	02/09
1	ORIGINAL ISSUE	MJK	06/04

TITLE:

**APPLICATION DRAWING FOR MONITORING  
WAITROSE COLDSTORE USING PA410**

PROJ.	DRG No:	SHT	OF	ISS.
	<b>03111</b>	1	1	2