


# Application Drawing for Connection Parasense 2200 to JTL Network using PA410

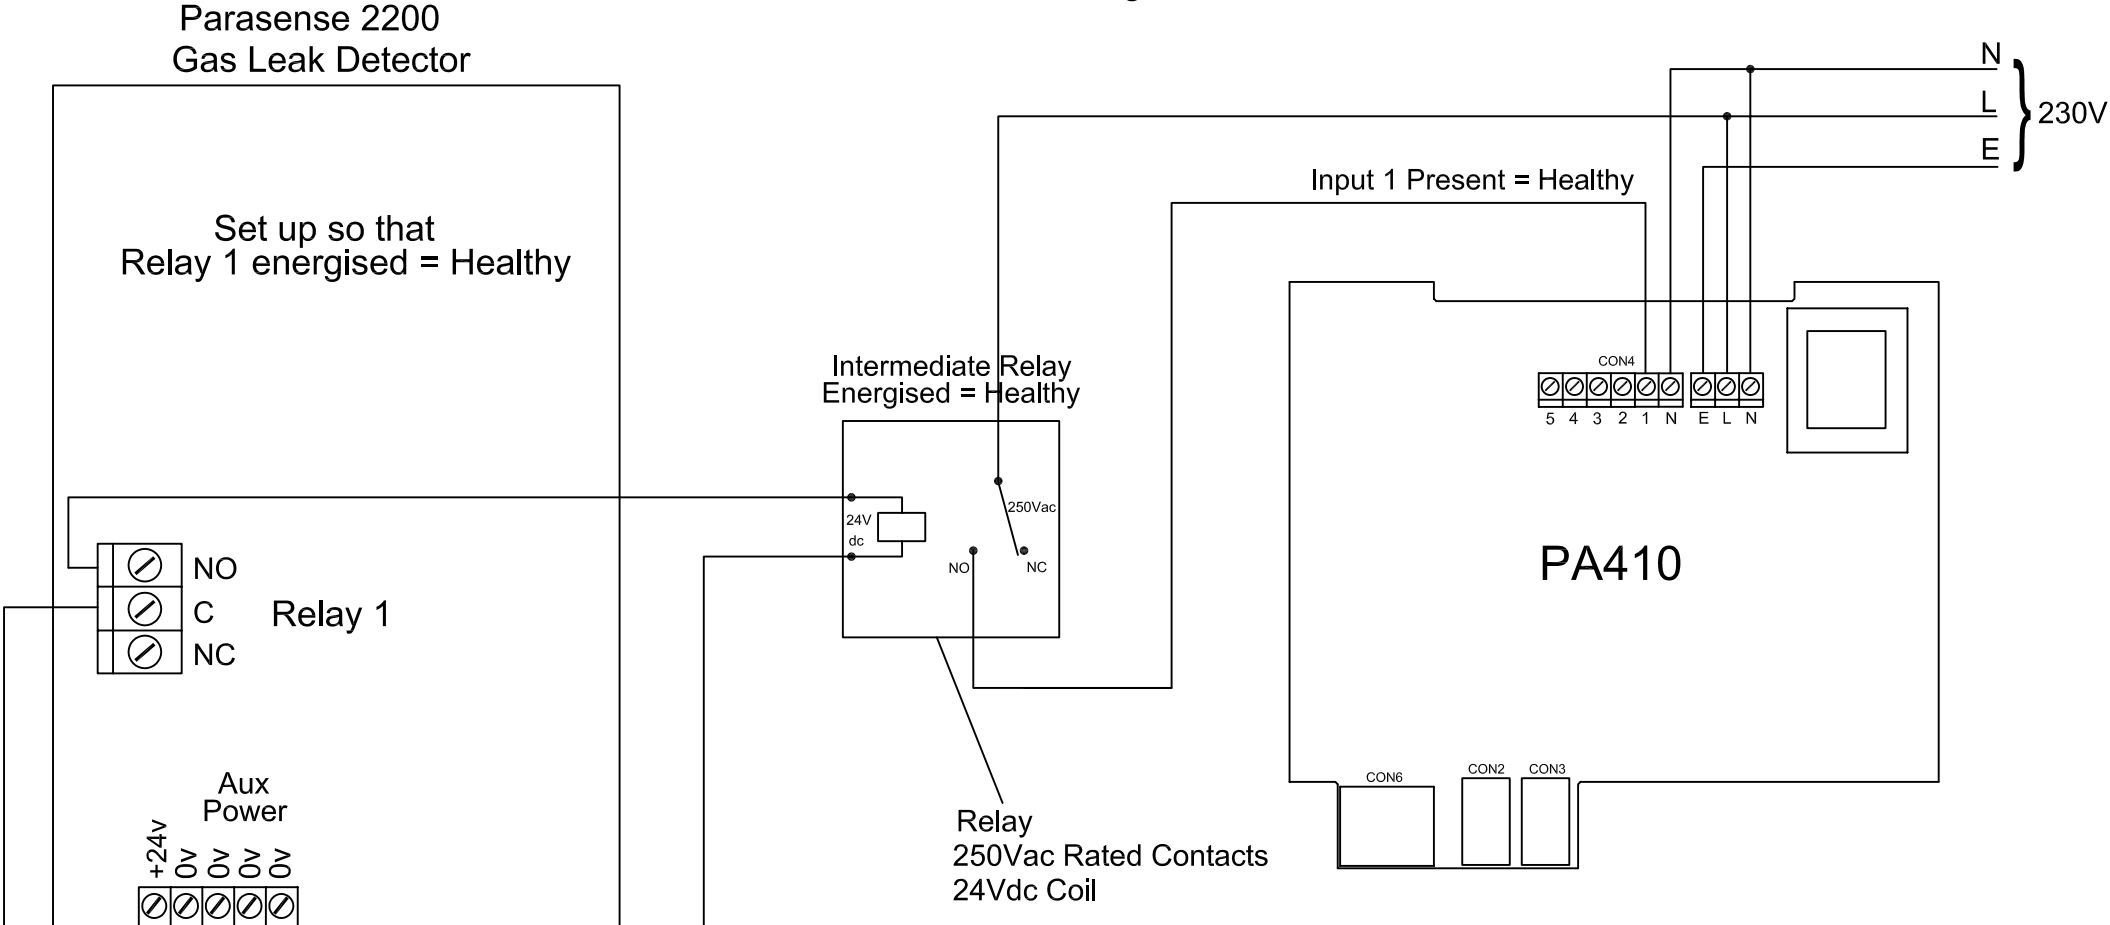

**NOTES:**

1. Unless otherwise specified, Inputs and supply to PA410 are 230Vac
2. Item 30 should be set to 3 (Alarm table 3) and Item 51 should be set to 2 (Refrigerant Gas Leak). Item 61 should be set to 1 (Alarm when input not present). Refer to Item Numbers and User Guide for further information.

JTL SYSTEMS LTD  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	10/04

TITLE:  
**Parasense 2200 Connecting to  
PA410 via Relay**

PROJ.	DRG No: <b style="font-size: 1.2em;">03124</b>	SHT	OF	ISS.
		<b>1</b>	<b>1</b>	<b>1</b>