


# HP120 DISCHARGE CONTROL APPLICATION DIAGRAM

## GENERAL ALARM OUTPUT

NOTE RELAYS ENERGISED WHEN THERE IS NO ALARM PRESENT

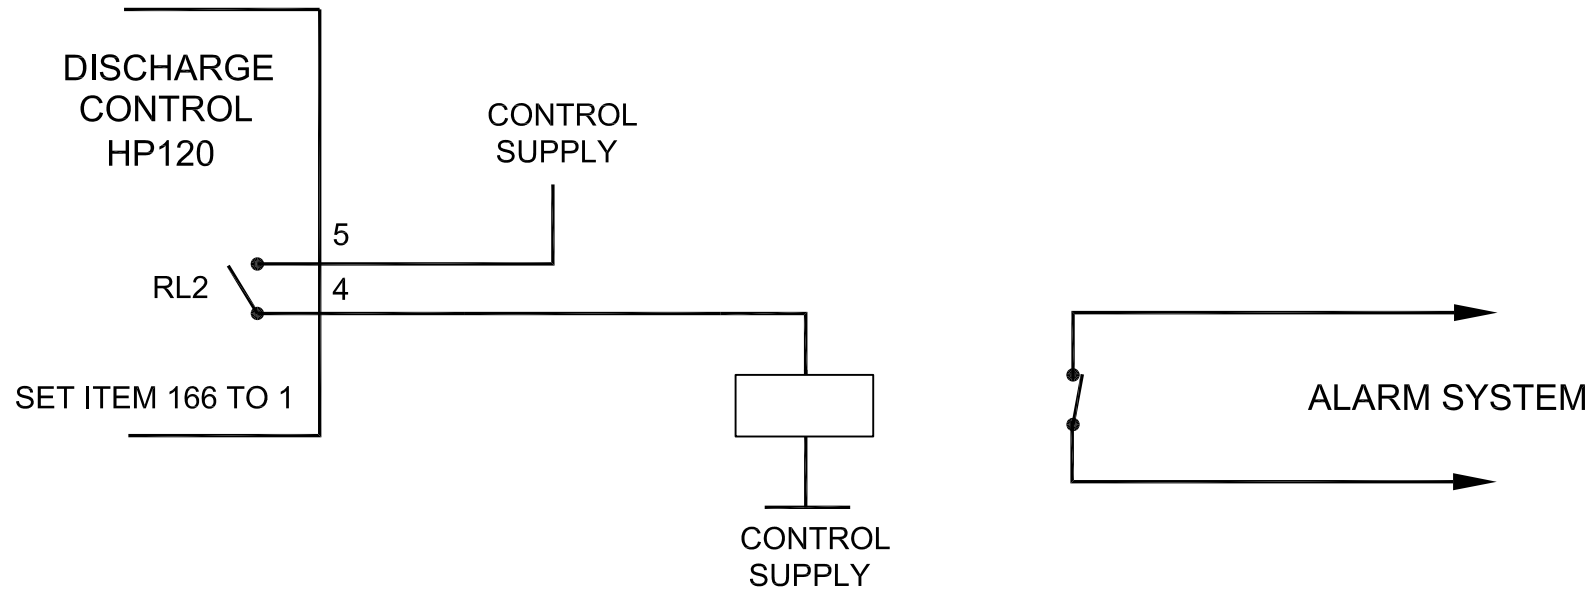

JTL SYSTEMS LTD  
 41 KINGFISHER COURT, HAMBRIDGE RD,  
 NEWBURY, BERKSHIRE: RG14 5SJ  
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	07/13

TITLE:  
 HP120 DISCHARGE CONTROL  
 APPLICATION DIAGRAM

PROJ.	DRG No:	SHT	OF	ISS.
	04135	1	1	1