



CONNECTION OF JTL RL271 PROTOCOL CONVERTER TO CBISS GASLEAK MONITOR (ARMS1 - RS232)

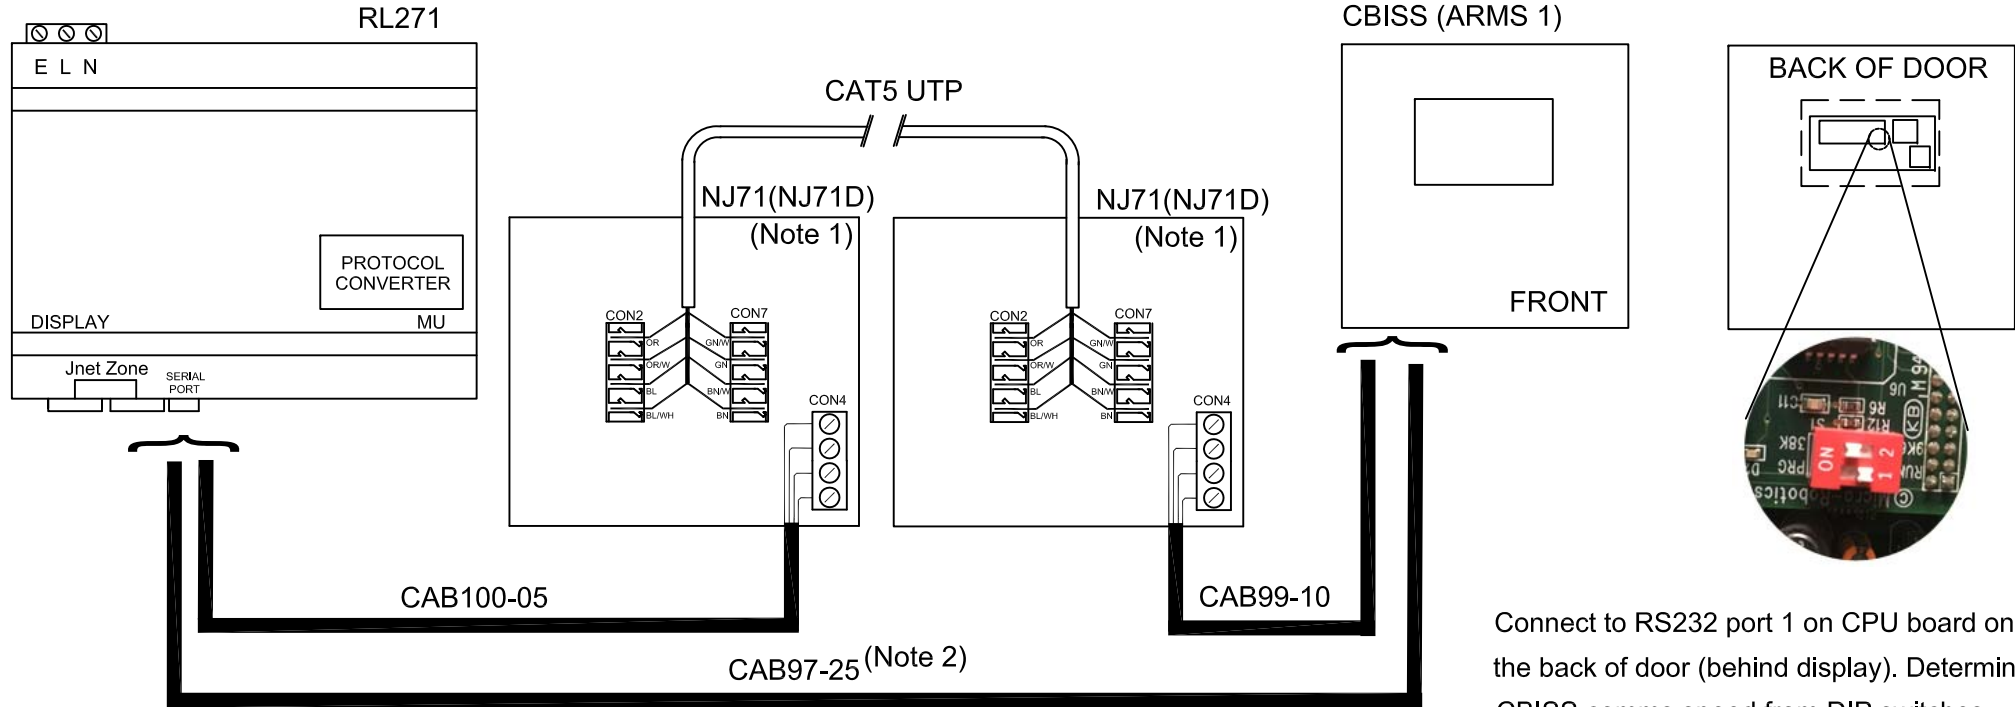

Connect to RS232 port 1 on CPU board on the back of door (behind display). Determine CBISS comms speed from DIP switches on CPU daughterboard. (See photo)

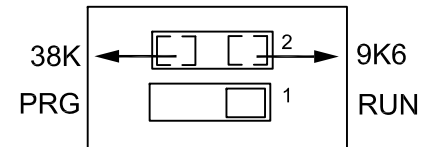

Adjust RL271 Item 39 accordingly
4=9600 (9K6) , 6=38.4 (38K)

NOTES:

1. Use NJ71 (wall mounted) or NJ71D (DIN rail mounted) as applicable.
2. Where RL271 is sited sufficiently close to CBISS equipment, extension via NJs and CAT5 will not be necessary. In this case a direct connection can be made with a CAB97-25.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

TITLE: CBISS (ARMS1 -RS232) Connection to RL271		PROJ:		ISSUE	DESCRIPTION	APP'D	DATE
DRG TYPE: APPLICATION DRAWING		DRG No: 04747		SHT OF ISS. 1 OF 1 1	1 ORIGINAL ISSUE	SzN	11/16