



TYPE 'ECCA' & 'ECCB' CABINET MONITOR

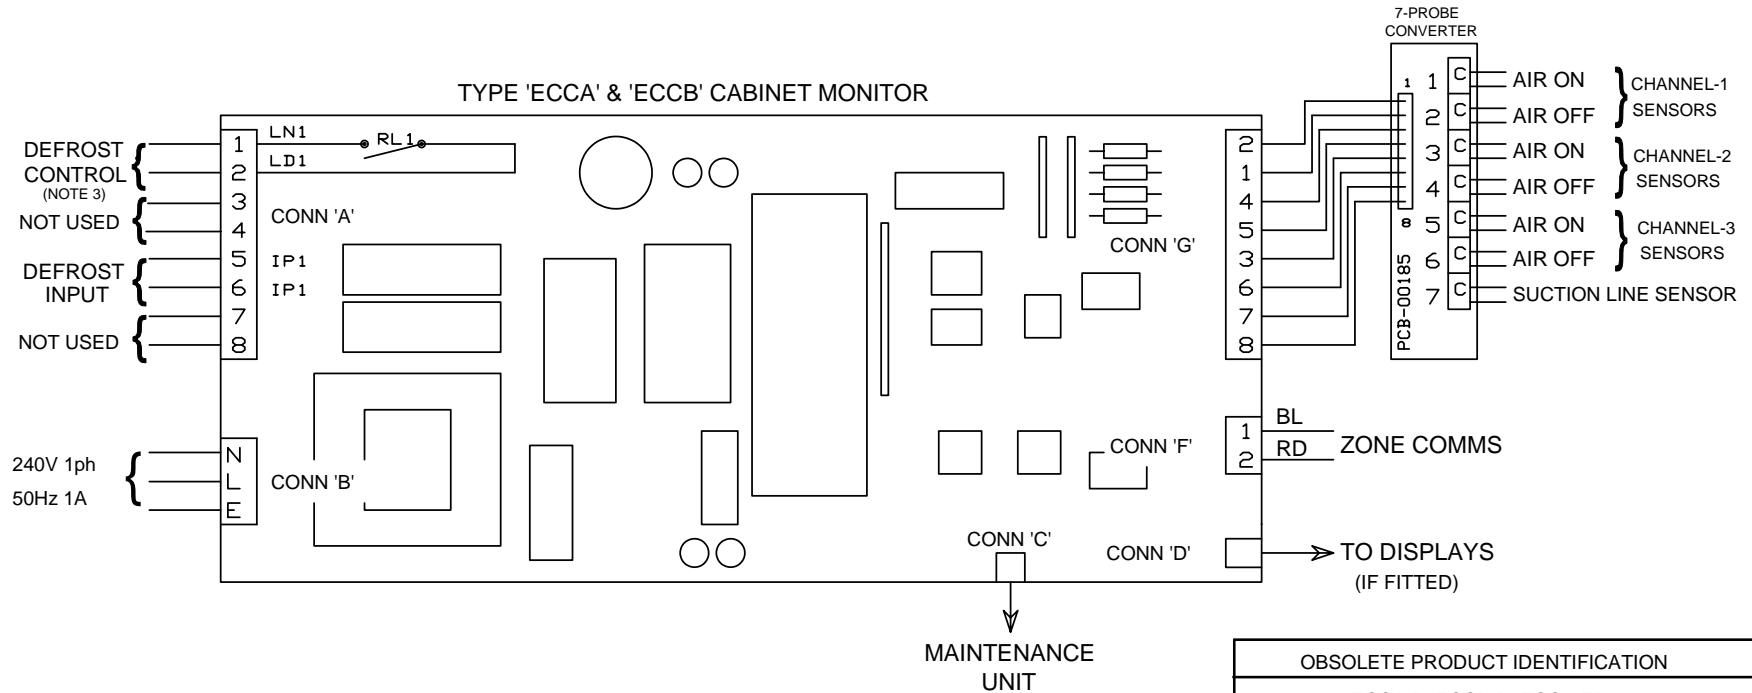

NOTES:

1. ON THE VOLT-FREE DEFROST INPUT (IP1), CLOSED CONTACT = DEFROST
2. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY, CONNECT LINE VOLTAGES TO TERMINALS PREFIXED 'LN' AND CORRESPONDING LOADS TO TERMINALS PREFIXED 'LD'.
3. TYPE 'ECCA-E' ONLY HAS DEFROST HEATER CONTROL FITTED. MAXIMUM LOAD 1A AT 240V ac.

OBSOLETE PRODUCT IDENTIFICATION			
ECCA-B, ECCB-B, ECCA-EB			
 JTL SYSTEMS LTD. 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ TEL: 01635-263646 FAX: 01635-263647			
ISSUE	DESCRIPTION	APP' D	DATE
4	CHANGED PRODUCT NAME	MJK	3/94
3	ECCA-E & ECCB ADDED, CONNE REMOVED	NMT	7/91
5	NAME CHANGED	MJK	11/94
TITLE: CABINET MONITOR WIRING			
TYPE: EWEC01 (ESCMCU)			
PRD. EC	DRG No' 00202	SHT 1	OF 1
		ISS 5	