


TYPE ECCT, ECCH, ECBC COLDSTORE CONTROLLER

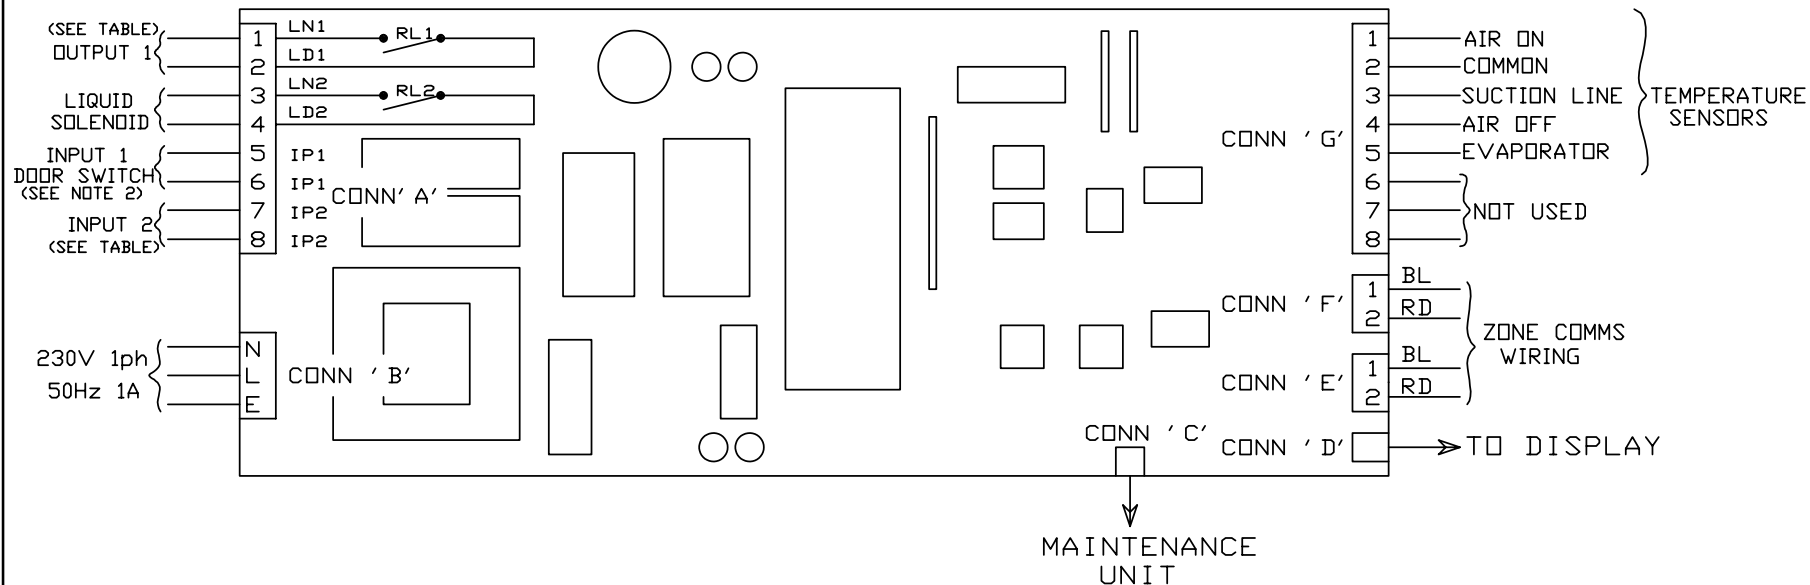

IMPORTANT NOTES:

1. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY: - ENSURE THAT LINE VOLTAGE IS CONNECTED TO TERMINALS LN1 & LN2 AND EACH LOAD IS CONNECTED TO THE CORRESPONDING TERMINAL LD1, LD2.
2. INPUTS IP1 & IP2 ARE VOLT-FREE INPUTS. APPLYING EXTERNAL VOLTAGE TO THEM CAUSES IRREPARABLE DAMAGE.

	ECCT	ECBC	ECCH
OUTPUT 1	DEFROST HEATER	DEFROST HEATER	ROOM HEATER
INPUT 2	EXTERNAL ALARM	BLAST CHILLING	EXTERNAL ALARM

JTL SYSTEMS LTD.
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE, RG14 5SJ
 TEL: 01635-263646 FAX: 01635-263647

ISS	DESCRIPTION	APP' D	DATE
3	UPDATED & ADDED TABLE	MJK	8/95
2	ADDED ECCH & ECBC	DLT	1/94
1	ORIGINAL ISSUE	NMT	2/91

TITLE: **TIMED DEFROST COLDSTORE CONTROLLER WIRING**
 TYPE: **ECCT, ECCH, ECBC**

PROJ.	DRG No:	SHT	OF	ISS
EC	00317	1	1	3