


POWER CONNECTIONS

SIGNAL CONNECTIONS

CR120 COLDSTORE MONITOR

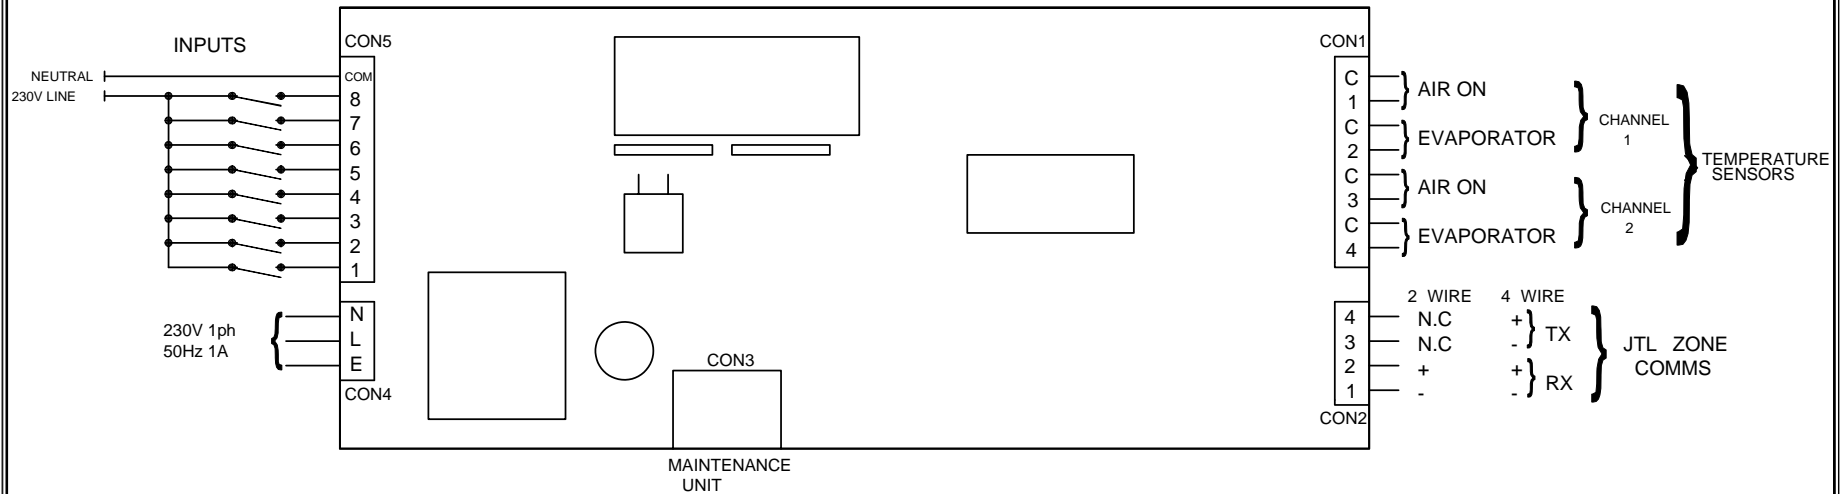

INPUTS *	SIGNAL	
1	DEFROST INITIATION	CHANNEL 1
2	DEFROST INITIATION	CHANNEL 2
3	DOOR CLOSED	CHANNEL 1
4	DOOR CLOSED	CHANNEL 2
5	PLANT ALARM 1	CHANNEL 1
6	PLANT ALARM 1	CHANNEL 2
7	PLANT ALARM 2	CHANNEL 1
8	PLANT ALARM 2	CHANNEL 2

ELECTRICAL SAFETY

THIS UNIT IS SUITABLE FOR SINGLE PHASE 230V OPERATION ONLY.
ON NO ACCOUNT SHOULD 3 PHASE (415V) CONNECTIONS BE MADE TO IT
i.e. THE INPUTS MUST BE ON THE SAME PHASE AS THE SUPPLY.

NOTE

* DEFROST AND PLANT INPUTS MAY BE SELECTED FOR EITHER LINE VOLTAGE PRESENT OR ABSENT INDICATING SIGNAL.

IF INPUTS ARE USED A NEUTRAL MUST BE CONNECTED TO CON5 - COM.

CE CONFORMANCE

This product conforms with EU standards when installed in accordance with the JTL installation requirements.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

		JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKS. RG14 5SJ TEL: 01635 263646 FAX: 01635 263647	
ISS	DESCRIPTION	APP'D	DATE
2	ADDED ELECTRICAL SAFETY NOTE	MJK	7/96
1	ORIGINAL ISSUE	MJK	2/96
TITLE: DUAL COLDSTORE MONITOR			
TYPE: CR120			
PROJ.	DRG No:	SHT	OF
	01668	1	1
			ISS. 2