


POWER CONNECTIONS

SIGNAL CONNECTIONS

TA110 TEMPERATURE MONITOR

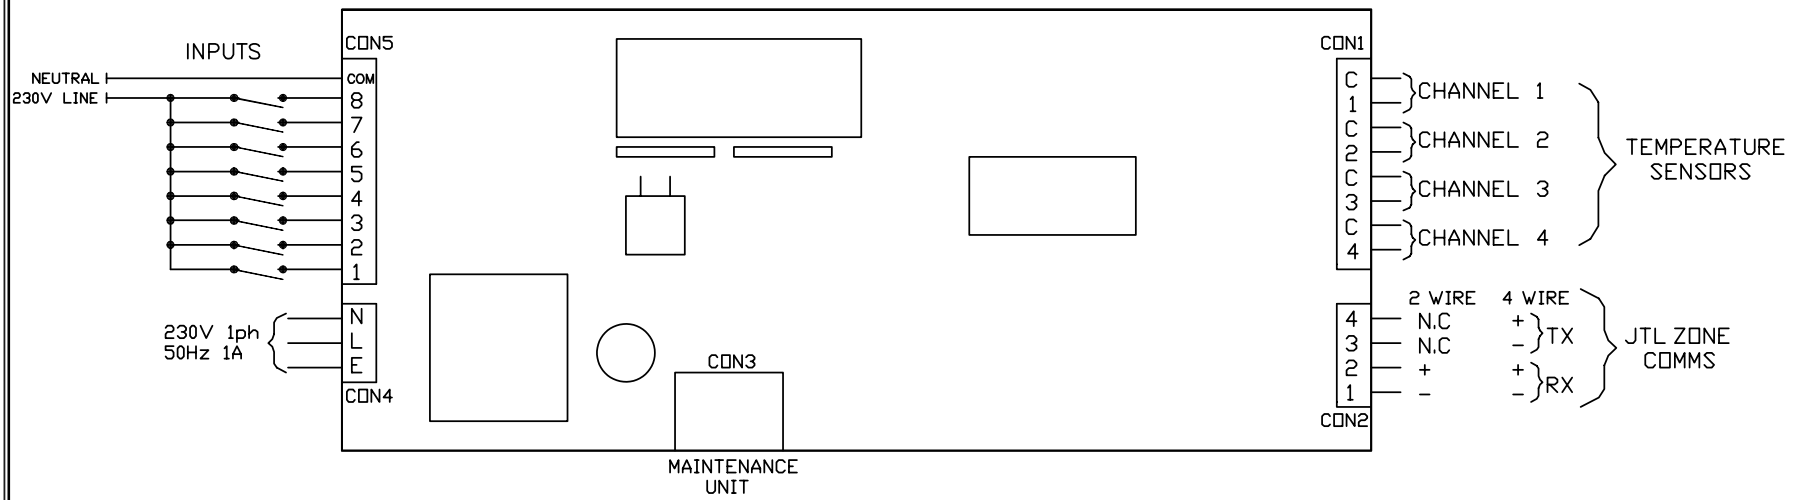

INPUTS*	SIGNAL	
1	} NOT USED	
2		
3		
4		
5	PLANT ALARM	CHANNEL 1
6	PLANT ALARM	CHANNEL 2
7	PLANT ALARM	CHANNEL 3
8	PLANT ALARM	CHANNEL 4

ELECTRICAL SAFETY
 THIS UNIT IS SUITABLE FOR SINGLE PHASE 230V OPERATION ONLY.
 ON NO ACCOUNT SHOULD 3 PHASE (415V) CONNECTIONS BE MADE TO IT
 i.e. THE INPUTS MUST BE ON THE SAME PHASE AS THE SUPPLY.

NOTE
 * PLANT INPUTS MAY BE SELECTED FOR EITHER LINE VOLTAGE PRESENT OR ABSENT INDICATING SIGNAL.
 IF INPUTS ARE USED A NEUTRAL MUST BE CONNECTED TO CON5 - COM.

CE CONFORMANCE
 This product conforms with EU standards when installed in accordance with the JTL installation requirements.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD NEWBURY, BERKSHIRE, RG4 5SJ TEL: 01635 263646 FAX: 01635 263647			
ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	10/96
TITLE: QUAD TEMPERATURE MONITOR			
TYPE: TA110			
PROJ.	DRG No	SHT	OF ISS
	01889	1	1 1