


POWER CONNECTIONS


SIGNAL CONNECTIONS

AI110 ANALOG MONITOR

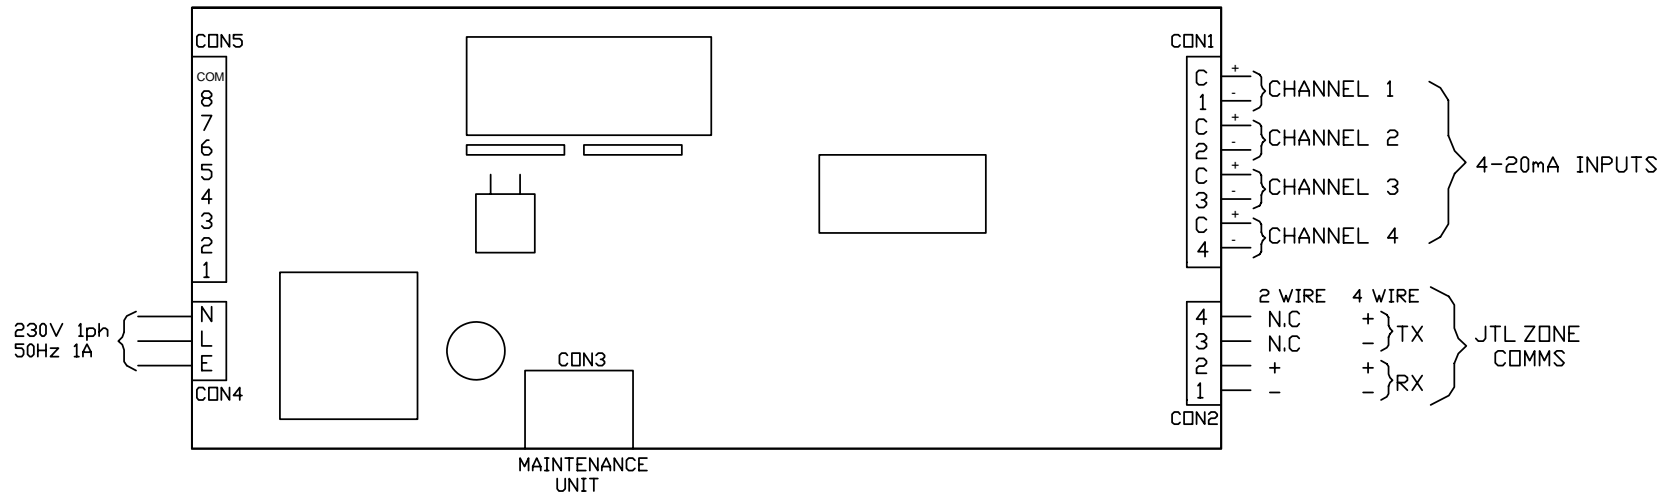

ELECTRICAL SAFETY
 THIS UNIT IS SUITABLE FOR SINGLE PHASE 230V OPERATION ONLY.
 ON NO ACCOUNT SHOULD 3 PHASE (415V) CONNECTIONS BE MADE TO IT
 i.e. THE INPUTS MUST BE ON THE SAME PHASE AS THE SUPPLY.

CE CONFORMANCE
 This product conforms with EU standards when installed in accordance with the JTL installation requirements.

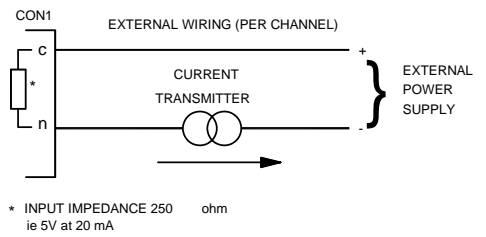

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD NEWBURY, BERKSHIRE RG4 5SJ TEL 01635-47585 FAX: 01635-31888		
ISSUE	DESCRIPTION	APP'D DATE
2	ADDED EXTERNAL WIRING	MJK 1/96
1	ORIGINAL ISSUE	MJK 10/96
TITLE:		
QUAD ANALOG MONITOR		
TYPE: AI110		
PROJ.	DRG No	SHT OF ISS
	01890	1 1 2