
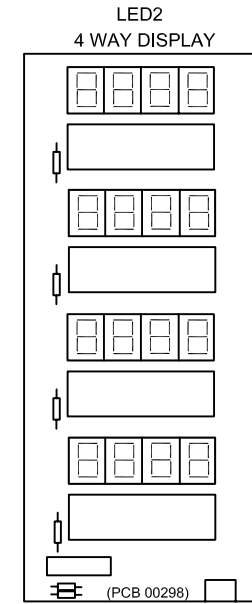


### CPLS COMPRESSOR CONTROLLER

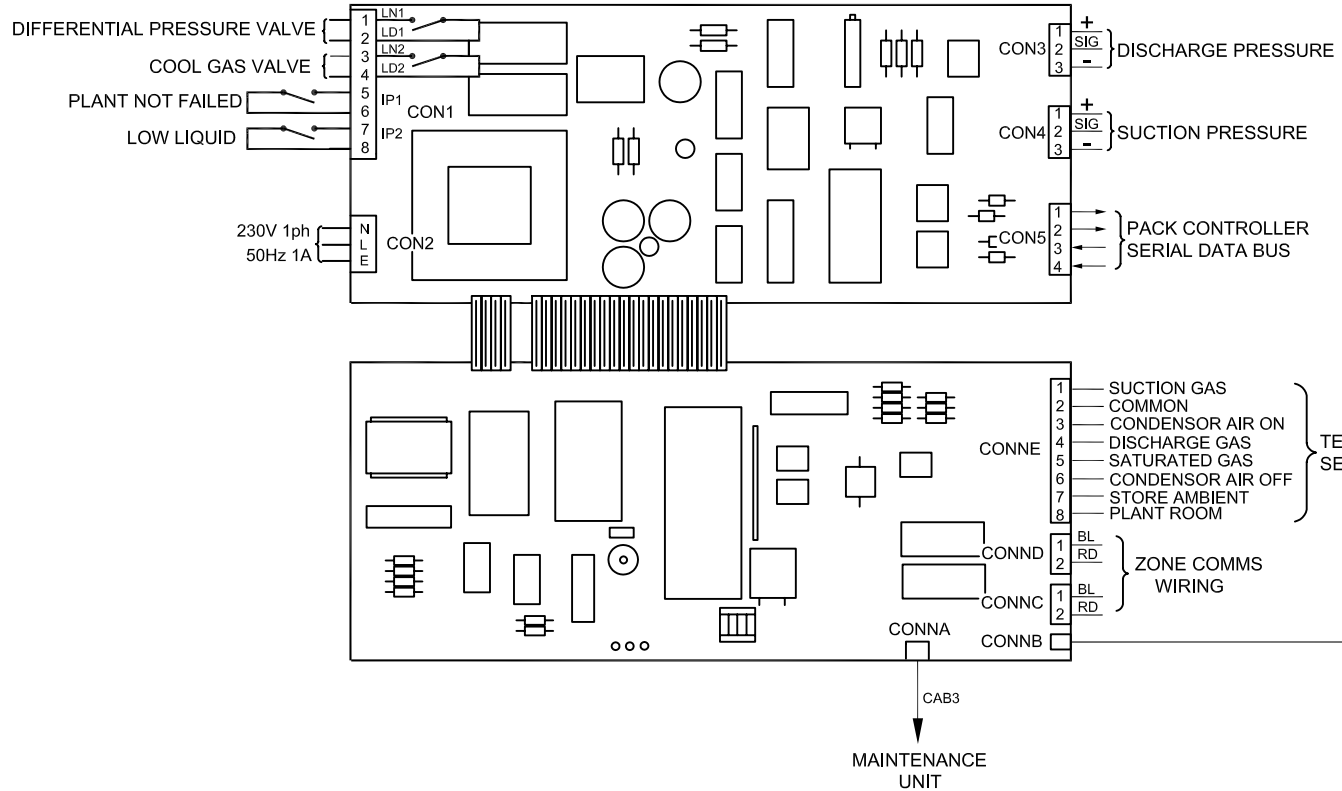


CAB6

MAINTENANCE UNIT

#### IMPORTANT NOTES:

1. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY:-  
ENSURE THAT LINE VOLTAGE IS CONNECTED TO TERMINALS LN1 - LN2  
AND EACH LOAD IS CONNECTED TO THE CORRESPONDING TERMINAL LD1 - LD2.
2. INPUTS IP1 & IP2 ARE VOLT-FREE INPUTS POWERED INTERNALLY FROM THE  
MAINS SUPPLY. NO EXTERNAL VOLTAGE IS TO BE APPLIED TO THEM TO AVOID  
EQUIPEMENT DAMAGE.

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP



**JTL SYSTEMS LTD**  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	07/01

TITLE: **COMPRESSOR CONTROLLER WIRING**

TYPE: CPLS

PROJ.	DRG No: <b>02665</b>	SHT <b>1</b> OF <b>1</b>	ISS. <b>1</b>
-------	----------------------	--------------------------	---------------