


IF12 JTL PLANT INTERFACE

Description:

JTL Plant Control Interface comprising 8 opto-isolated mains digital inputs and 3 suppressed changeover relay outputs. A JTL Maintenance Unit is used to configure this product.

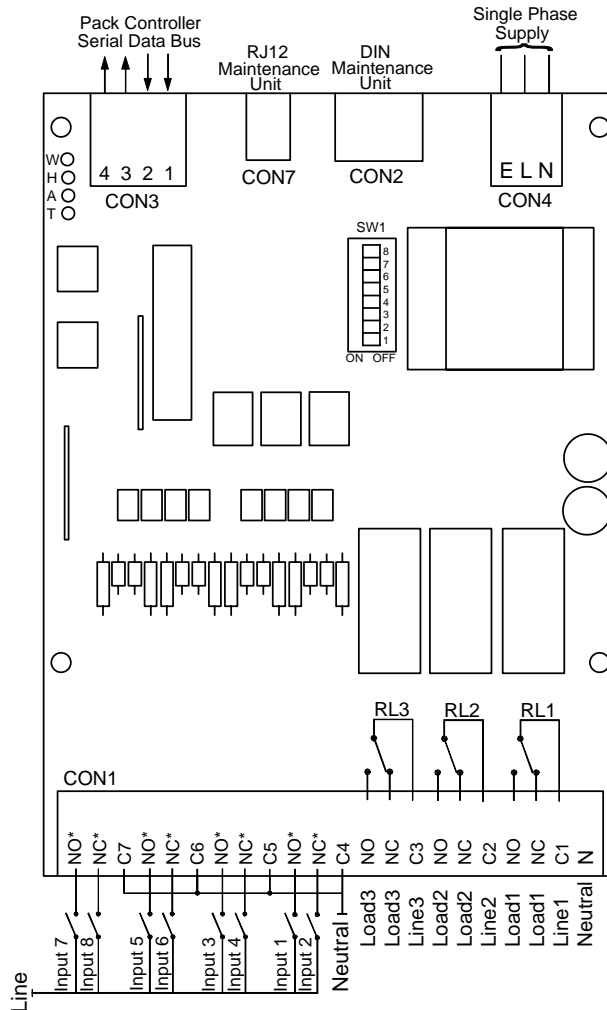

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

NOTES:

1. Input states as follows:
Closed contact = Input present
Open contact = Input not present
2. Output contacts shown de-energised.
3. C4, C5, C6, C7 must have neutral connected to them, and their 'NO' and 'NC' terminals (marked*) are used for inputs as shown.
4. C1, C2, C3 must have line connected to them and their respective 'NO' and 'NC' terminals must have corresponding load connected. This ensures the correct operation of internally fitted suppressors.
5. Switch positions:
DIP switch SW1 controls the output relays if pack serial data bus communications fail. Switch closed (ON) = corresponding output relay energised.
6. Interface must be configured according to function using JTL Maintenance Unit.

JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE, RG14 5SJ TEL: 01635 263646 FAX: 01635 263647			
ISSUE	DESCRIPTION	APPD	DATE
1	ORIGINAL ISSUE	MJK	07/02
TITLE: <b style="text-align: center;">IF12 PLANT INTERFACE WIRING			
PROJ.	DRG No: <b style="text-align: center;">02764	SHT 1	OF 1
			ISS. 1