


PACK CONTROLLER SERIAL DATA BUS 230V 1 ph  
50Hz 1 A

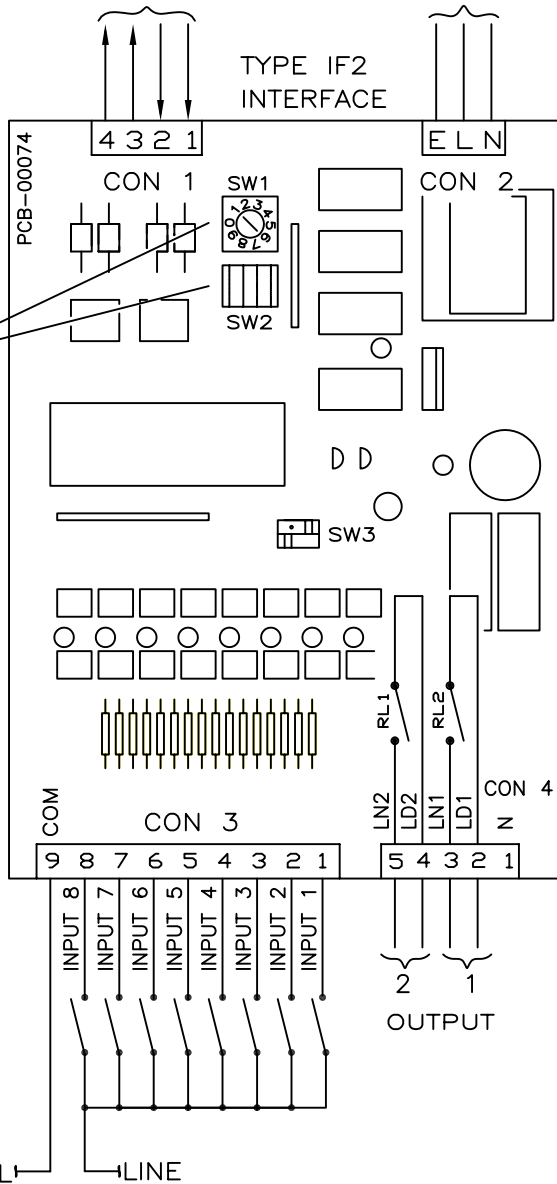

**NOTE**  
THE SWITCHES SW1 & SW2 SET THE INTERFACE FUNCTIONALITY. SEE THE RELEVANT APPLICATION DRAWINGS FOR THE CORRECT SETUP.

**NOTES**

- INPUT STATES AS FOLLOWS:-  
CLOSED CONTACT = ON  
OPEN CONTACT = OFF
- CON3 TERMINAL 9 MUST HAVE NEUTRAL CONNECTED TO IT.
- TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY, CONNECT LINE VOLTAGES TO TERMINALS PREFIXED 'LN' AND THE CORRESPONDING LOADS TO TERMINALS PREFIXED 'LD'.
- SWITCH SETTINGS**  
SWITCHES 'SW3' CONTROL THE OUTPUT RELAYS IF PACK SERIAL DATA BUS COMMUNICATIONS FAIL. (CLOSED 'DOT SHOWING' = RELAY ENERGISED).
- IF2/2 SHOWN, IF2/1 HAS RELAY 1 ONLY.

**JTL SYSTEMS LTD.**  
41. KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE. RG14 5SJ  
TEL: 01635-263646 FAX: 01635-263647

ISSUE	DESCRIPTION	APP'D	DATE
1	ORIGINAL ISSUE	MJK	11/02

TITLE:  
PLANT INTERFACE CONNECTIONS  
TYPE: IF2

PROJ.	DRG No	SHT	OF	ISS.
CP	02881	1	1	1