


PA410 UNIVERSAL PLANT ALARM MONITOR CONNECTION DRAWING



NOTES:

1. Unless specified differently supply is 230 Vac mains and inputs are 230 Vac mains digital. 110 Vac and 24 Vac options are available.
2. This unit is NOT suitable for 415 V use.
3. Input Line voltage should be connected to the numbered terminals and the neutral to the terminal marked N (common neutral).

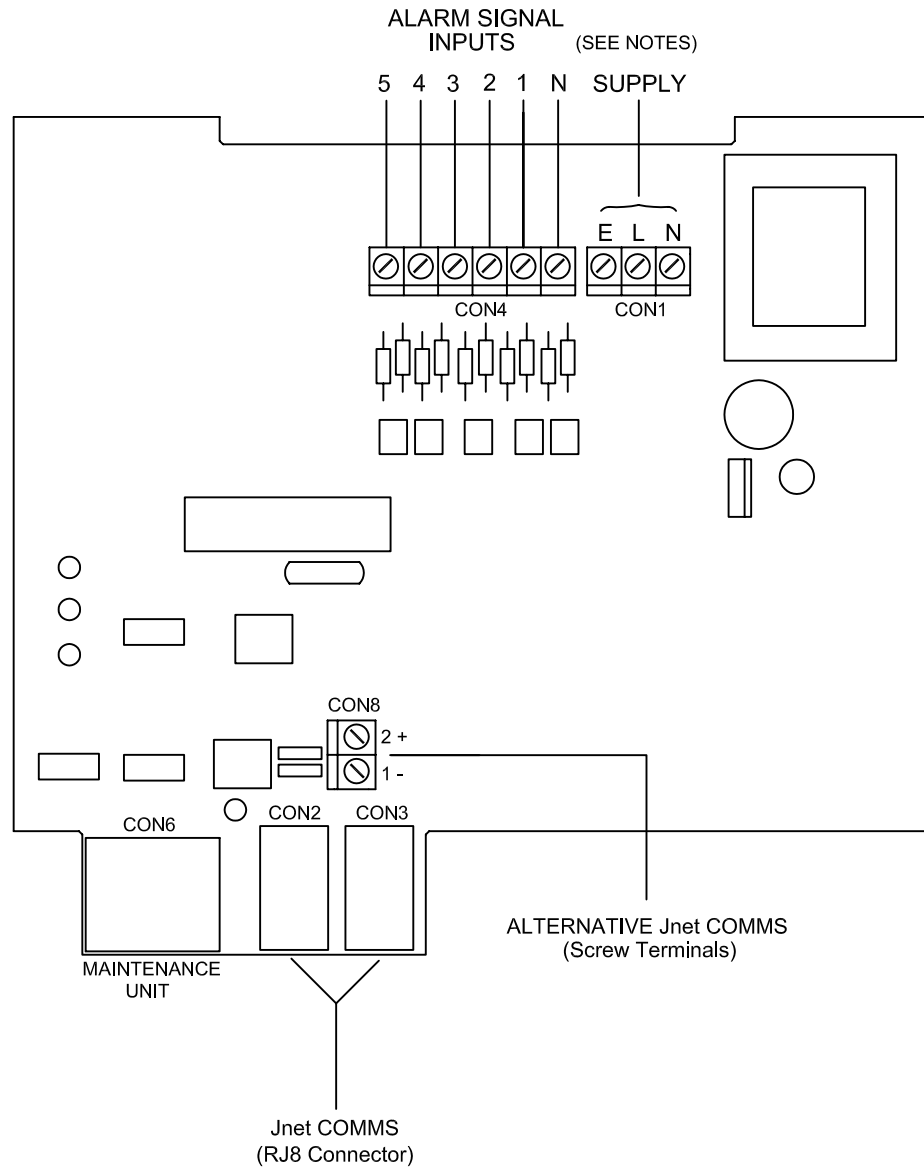

JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	TITLE CHANGED FROM APPLICATION TO CONNECTIONS	MJK	12/09
2	NOTE 2 CHANGED	MJK	02/09
4	UPDATED NOTES	MJK	01/15

TITLE: PA410
 UNIVERSAL PLANT ALARM MONITOR (5 INPUTS)
 CONNECTION DRAWING

PROJ.	DRG No:	SHT	OF	ISS.
	03105	1	1	4

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP