



LACI COLDROOM CONTROLLER CONNECTIONS

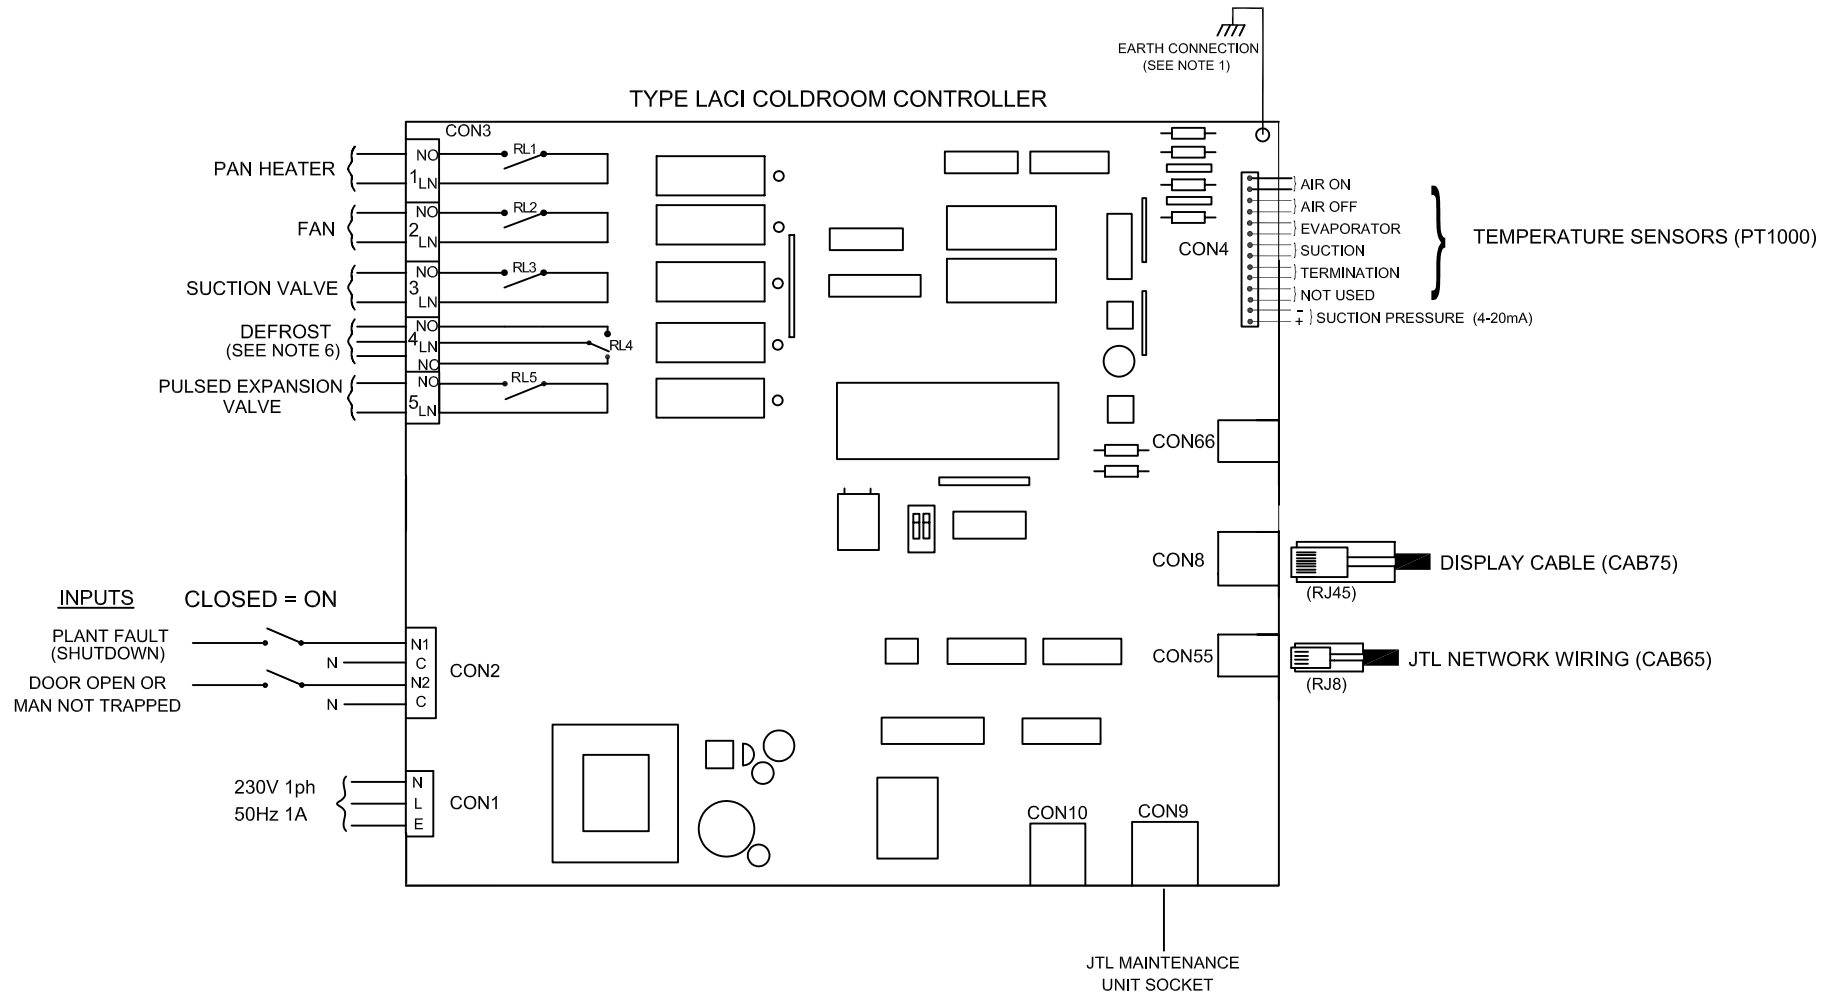

NOTES:

1. THE LACI CONTROLLER MUST BE EARTHED TO THE CHASSIS VIA THE CONTROLLER FIXING HOLE AS SHOWN.
2. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
3. INPUTS REQUIRE 'C' CONNECTED TO NEUTRAL AND THE INPUT TO 230Vac WHEN SIGNAL IS PRESENT.
4. PLANT INPUTS TO CON2 MUST BE ON THE SAME PHASE AS THE SUPPLY ON CON1.
THIS UNIT IS NOT RATED FOR 415V
5. THE DEFROST OUTPUT HAS CHANGEOVER CONTACTS. SELECT THE APPROPRIATE OUTPUT FOR THE APPLICATION.
6. THE DEFROST OUTPUT HAS CHANGEOVER CONTACTS. SELECT THE APPROPRIATE OUTPUT FOR THE APPLICATION.
7. TO ENSURE THAT INTERNALLY FITTED SUPPRESSORS WORK CORRECTLY:- ENSURE THAT THE LINE VOLTAGE IS CONNECTED TO TERMINALS 'LN' AND EACH LOAD IS CONNECTED TO TERMINALS MARKED 'NO' OR 'NC.'

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

		JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY BERKSHIRE: RG14 5SJ TEL: 01635 263646 FAX: 01635 263647		
		ISS	DESCRIPTION	APP'D
3	ADDED DOOR OPEN ON CON2	MJK	10/11	
2	UPDATED TITLE	MJK	10/09	
1	ORIGINAL ISSUE	MJK	11/08	
TITLE: PULSED EXPANSION VALVE COLDROOM CONTROLLER CONNECTIONS				
TYPE: LACI				
PROJ.	DRG No:	SHT	OF	ISS.
LA	03490	1	1	3