


IF35 PLANT INTERFACE ANALOGUE (0-10V)



NOTES:

1. Inputs are volt free contacts using internal 15V ac supply.
2. To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. 1 must have control supply neutral connected to it.
3. See relevant application drawings for input/output functions.

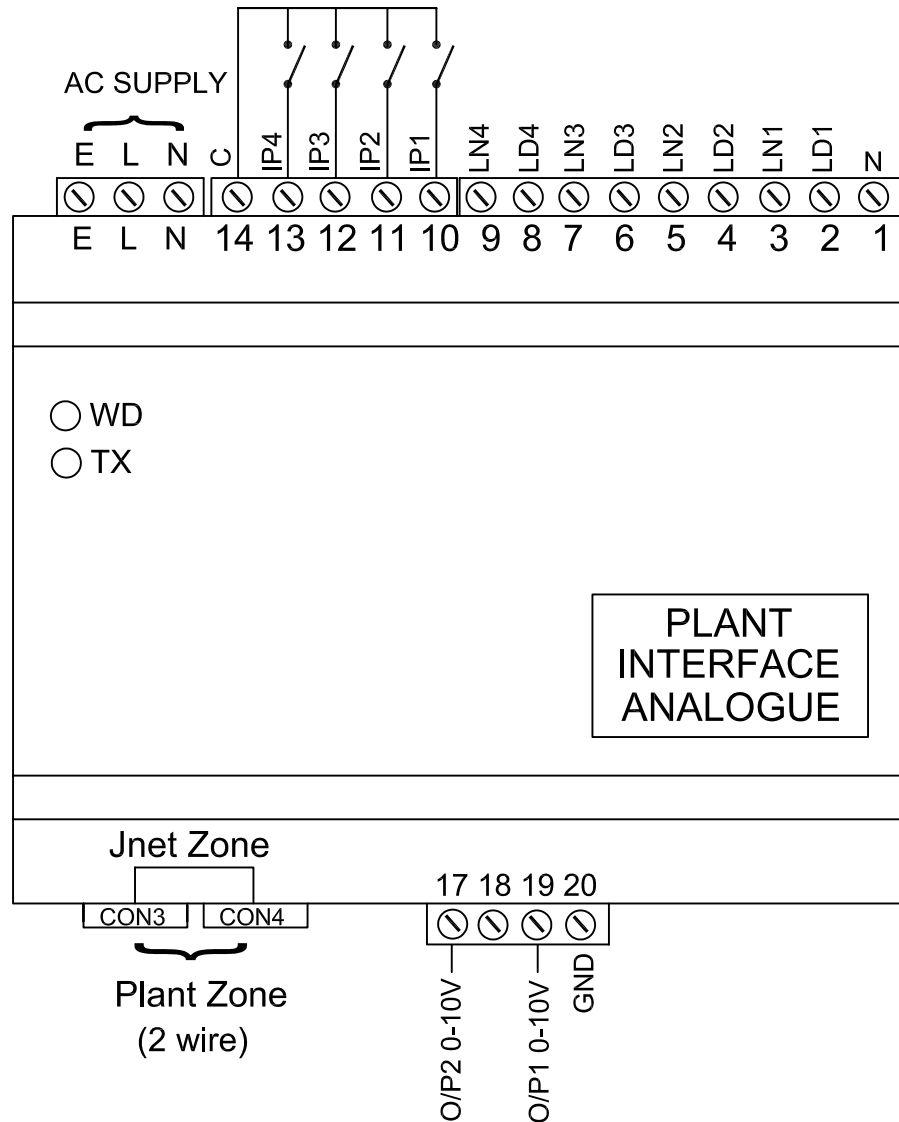

JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	ADDED NUMBERS FOR OUTPUT CONN	MJK	10/10
2	ADDED NOTES & UPDATED DRG	MJK	10/09
1	ORIGINAL ISSUE	MJK	08/09

TITLE:

IF35 PLANT INTERFACE ANALOGUE (0-10V)

PROJ.	DRG No:	SHT	OF	ISS.
	03562	1	1	3