


ND220 DEFROST TIME SCHEDULER



NOTES:

1. AUTO INPUT CLOSED FOR AUTO.
2. WATCHDOG ENERGISED FOR HEALTHY.
3. To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. Terminal 1 must have control supply neutral connected to it.

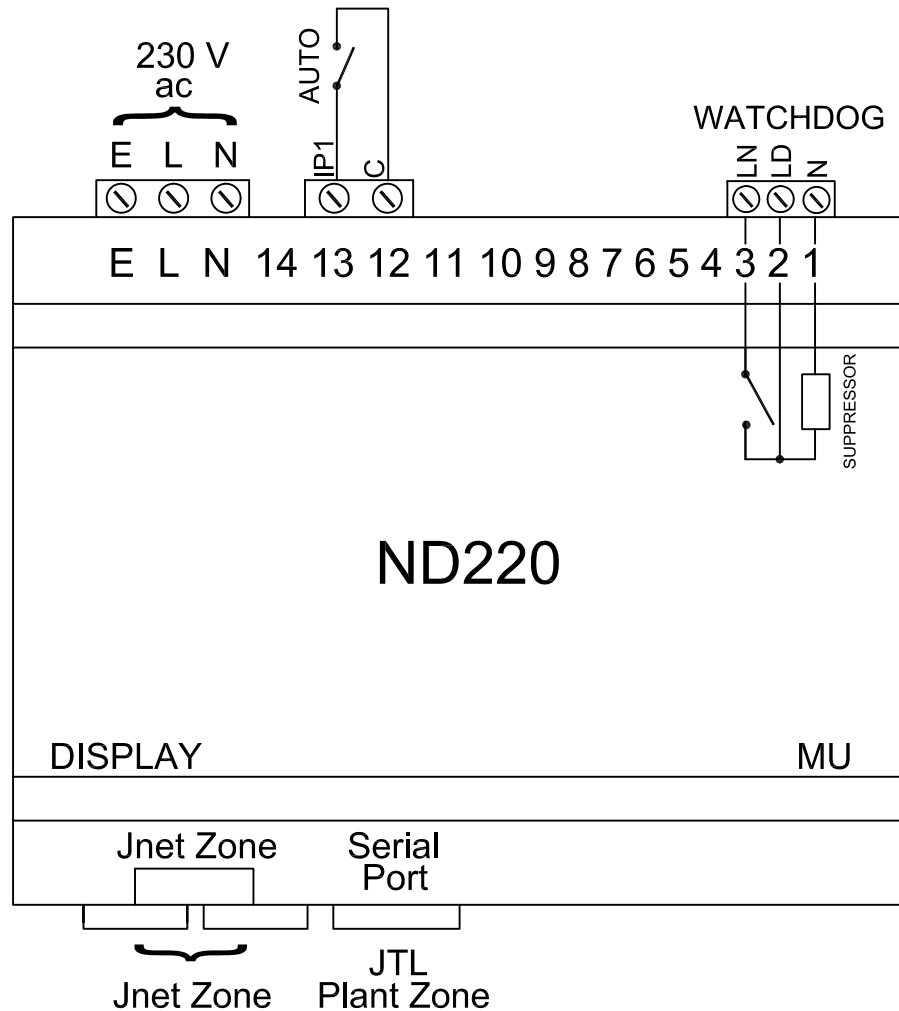

JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
2	CHANGED CONNECTIONS 12,13 TO 2 WAY	MJK	07/10
1	ORIGINAL ISSUE	MJK	04/10

TITLE:
ND220 DEFROST TIME SCHEDULER

PROJ.	DRG No:	SHT	OF	ISS.
	03672	1	1	2