


# HP120 DISCHARGE PRESSURE CONTROL



## NOTES:

1. Inputs are volt free contacts using internal 15V ac supply.
2. To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. 1 must have control supply neutral connected to it.
3. See relevant application drawings for input/output functions.
4. Note Relay 4 is NOT a suppressed output.
5. Split circuit or Alarms Healthy output choice selectable on Item 166

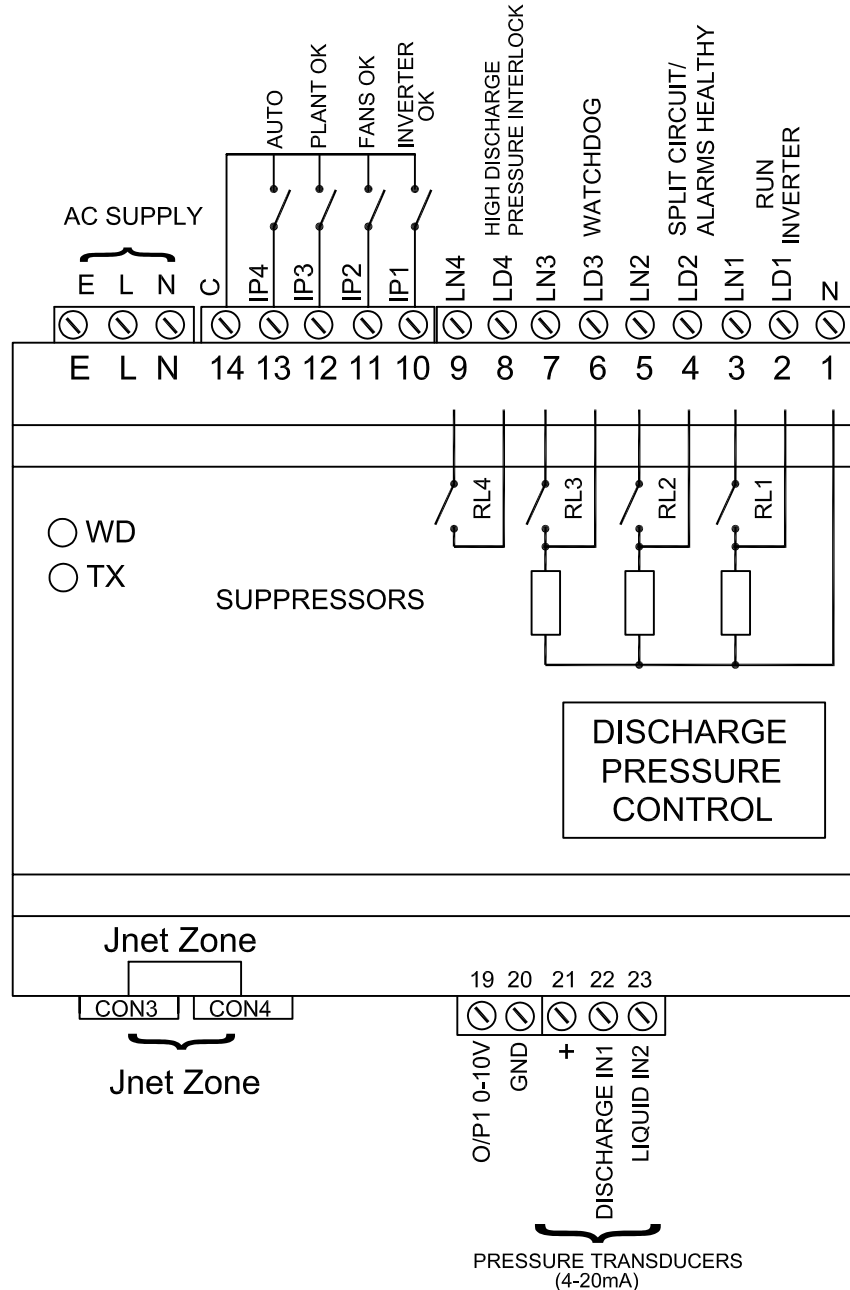

JTL SYSTEMS LTD  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	ADDED NOTE 4	MJK	02/11
2	AMENDED DESCRIPTION & UPDATED CONN'S	MJK	08/10
4	NOTE 5 ADDED	MJK	07/13

TITLE:  
HP120  
DISCHARGE PRESSURE CONTROL

PROJ.	DRG No:	SHT	OF	ISS.
	03711	1	1	4