


LP210 COMPRESSOR CONTROL



NOTES

- To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. Terminal 1 must have control supply neutral connected to it.
- Inputs 2 & 3 use a common multiplexed input.

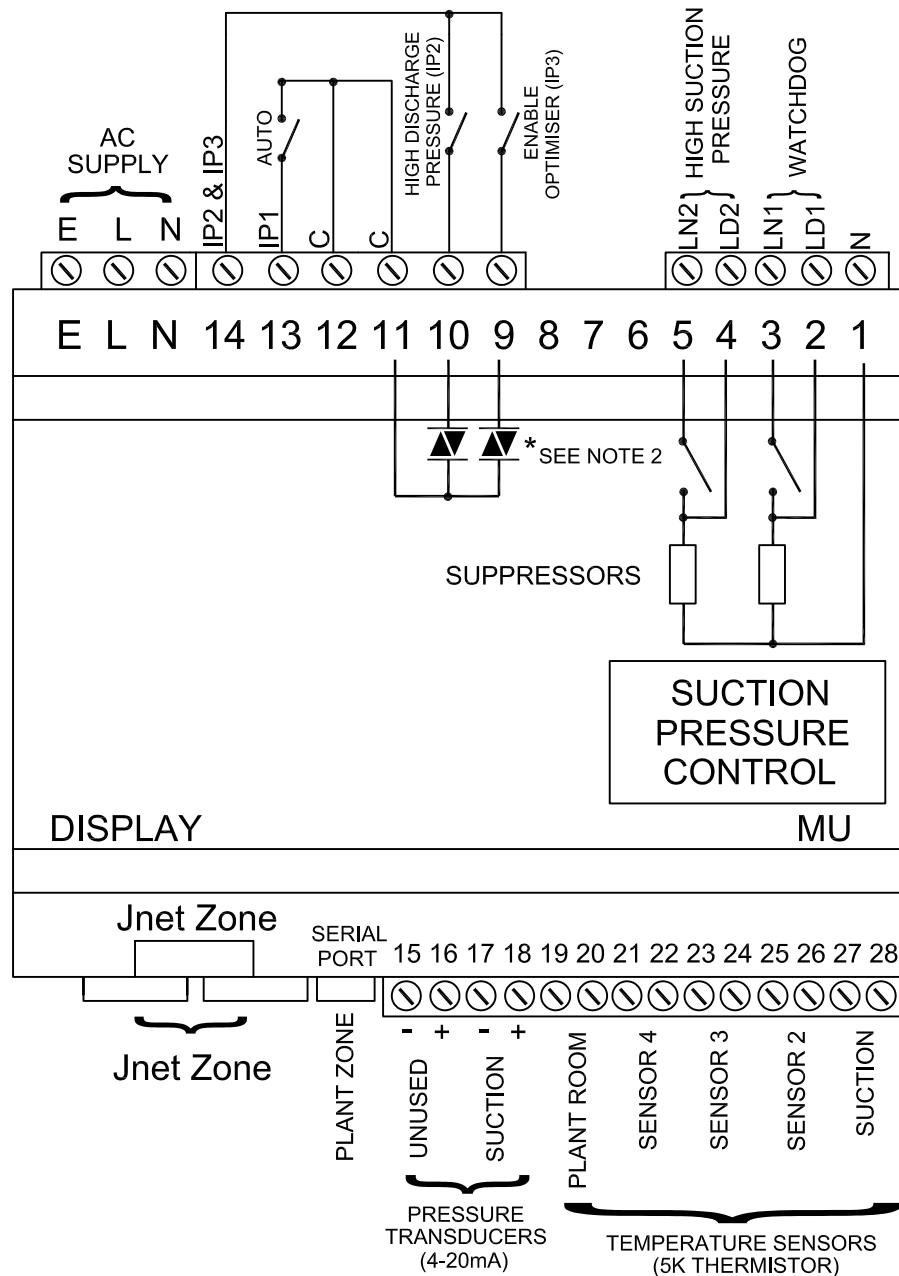

JTL SYSTEMS LTD
41 KINGFISHER COURT, HAMBRIDGE RD,
NEWBURY, BERKSHIRE: RG14 5SJ
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
6	UPDATED INPUTS & ADDED NOTE 2	MJK	02/12
5	LD6 UPDATED TO DISCHARGE PRESSURE	MJK	02/11
4	UPDATED CONNECTIONS	MJK	02/11

TITLE:
LP210 COMPRESSOR CONTROL

PROJ.	DRG No:	SHT	OF	ISS.
	03713	1	1	6