


LP120 COMPRESSOR CONTROL



NOTES:

1. Inputs are volt free contacts using internal 15V ac supply.
2. To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Ensure neutral is connected to terminal marked N. 1 must have control supply neutral connected to it.
3. See relevant application drawings for input/output functions.
4. Note Relay 4 is NOT a suppressed output.

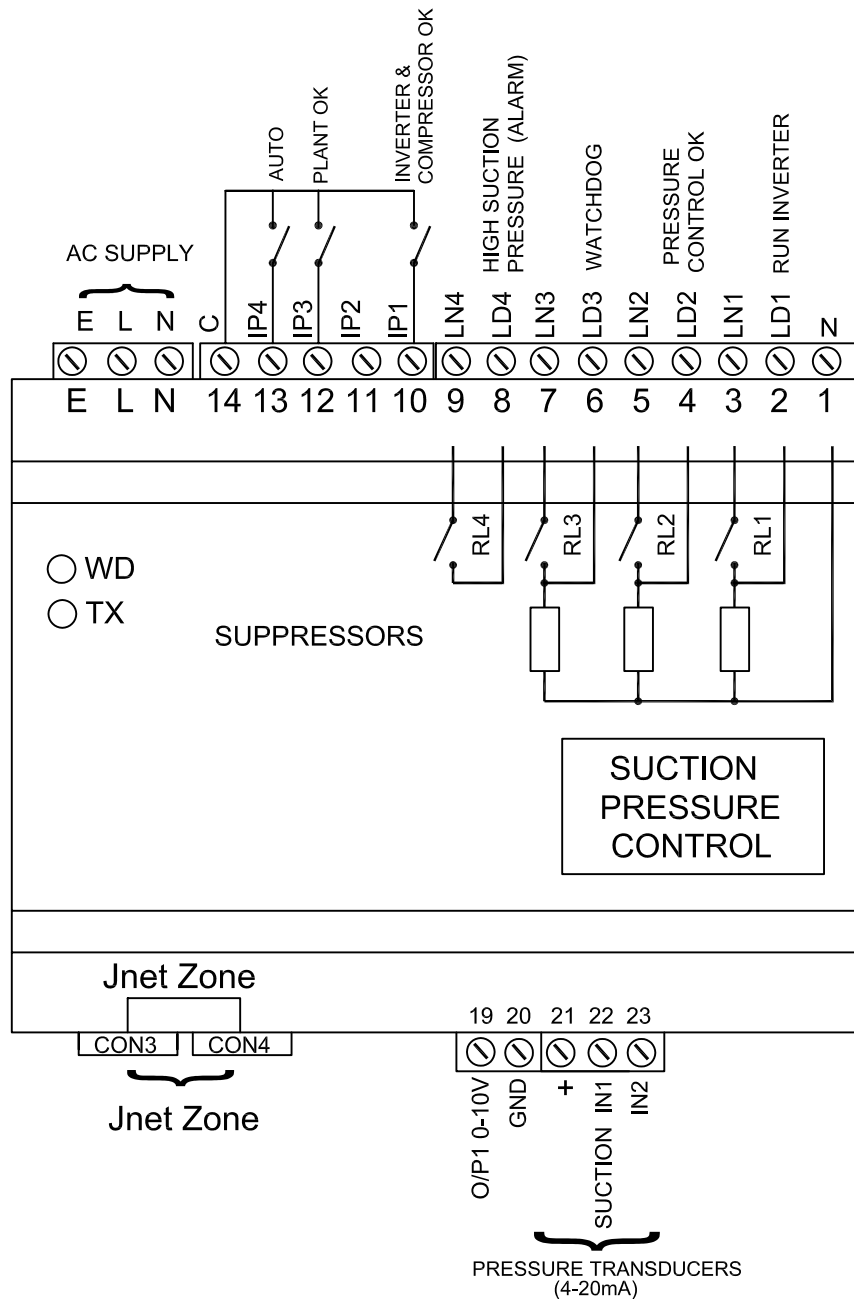

JTL SYSTEMS LTD
41 KINGFISHER COURT, HAMBRIDGE RD,
NEWBURY, BERKSHIRE: RG14 5SJ
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	IP3 & LD2 CONNECTION TEXT UPDATED	MJK	10/10
2	IP1 CONNECTION TEXT UPDATED	MJK	09/10
4	ADDED NOTE 4	MJK	02/11

TITLE:

LP120 COMPRESSOR CONTROL

PROJ.	DRG No:	SHT	OF	ISS.
	03721	1	1	4