


PA411 UNIVERSAL PLANT ALARM MONITOR CONNECTION DRAWING



NOTES:

1. Unless specified differently supply is 230 Vac mains and inputs are volt free. 110 Vac and 24 Vac supply options are available.
2. External voltage MUST NOT be used to turn on inputs.

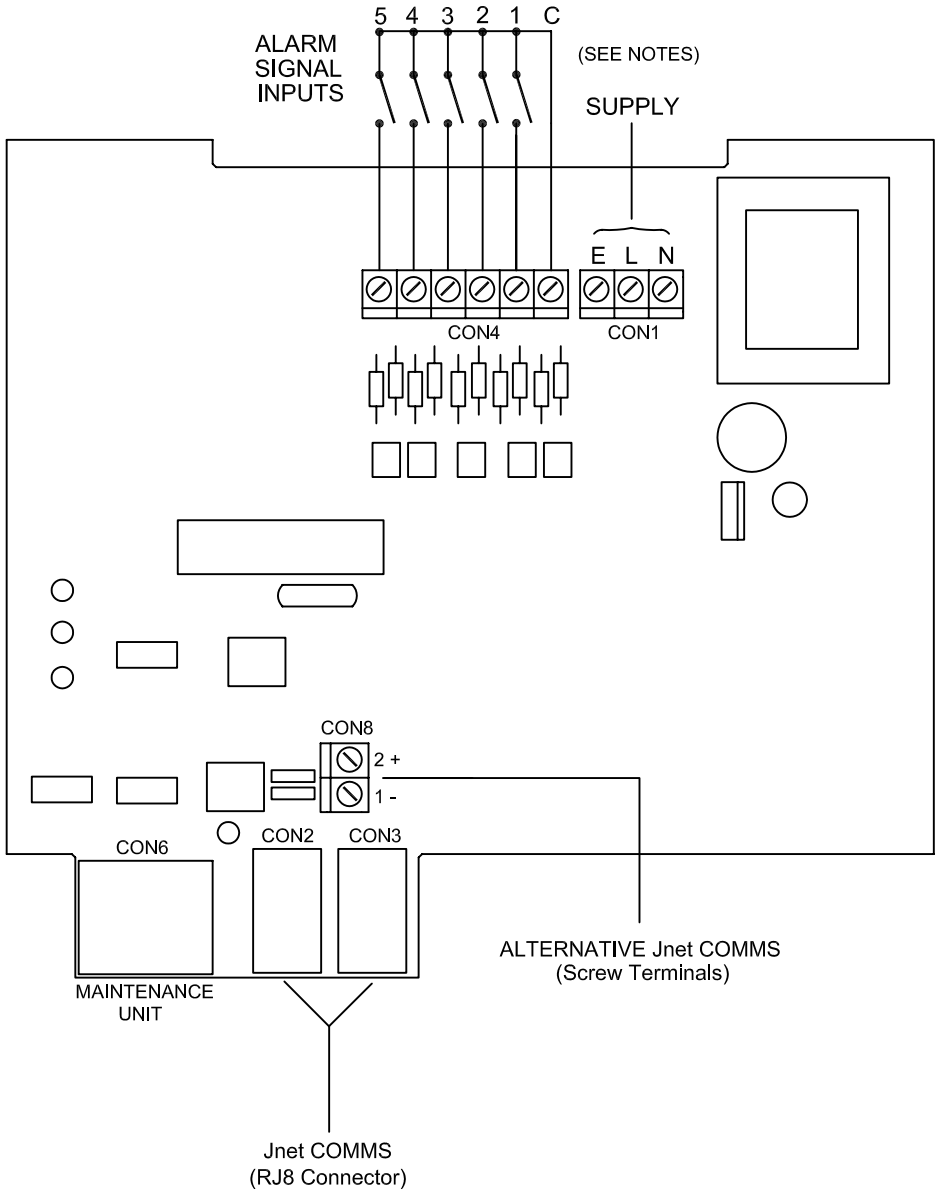

JTL SYSTEMS LTD  
 41 KINGFISHER COURT, HAMBRIDGE RD,  
 NEWBURY BERKSHIRE: RG14 5SJ  
 TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
2	UPDATED NOTES	MJK	01/15
1	ORIGINAL ISSUE	MJK	09/10

TITLE:  
**PA411  
 UNIVERSAL PLANT ALARM MONITOR (5 INPUTS)  
 CONNECTION DRAWING**

PROJ.	DRG No:	SHT	OF	ISS.
	03733	1	1	2

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP