UACI COLDROOM CONTROLLER

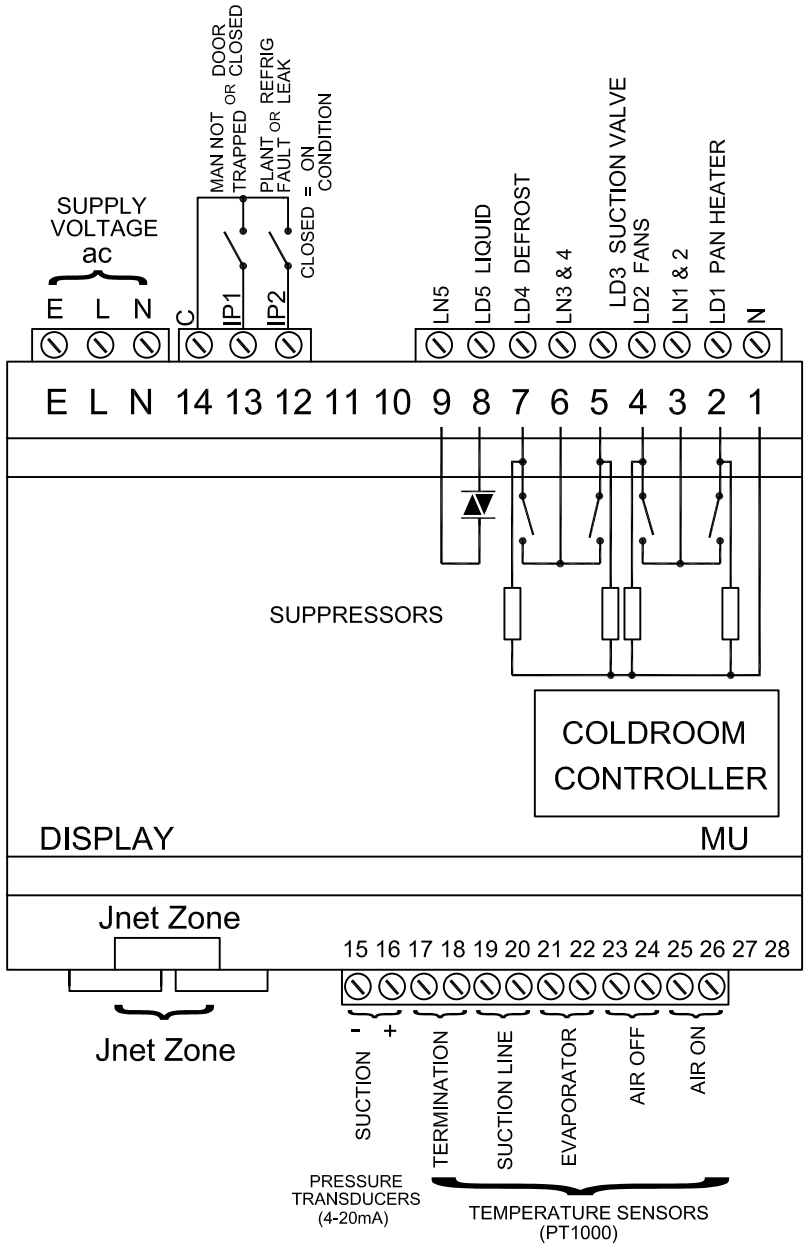

NOTE

1. To ensure that internally fitted suppressors work correctly, connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed LD. Terminal 1 (N) must have control supply neutral connected to it.

JTL SYSTEMS LTD
41 KINGFISHER COURT, HAMBRIDGE RD,
NEWBURY, BERKSHIRE: RG14 5SJ
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
6	ADDED DOOR CLOSED TO IP1	MJK	11/12
5	ADDED RERIG LEAK TO IP2	MJK	05/12
4	IP1 UPDATED & ADDED IP2	MJK	08/11

TITLE: UACI COLDROOM CONTROLLER

PROJ.	DRG No:	SHT	OF	ISS.
	03789	1	1	6

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP