



ZM15 CONNECTIONS

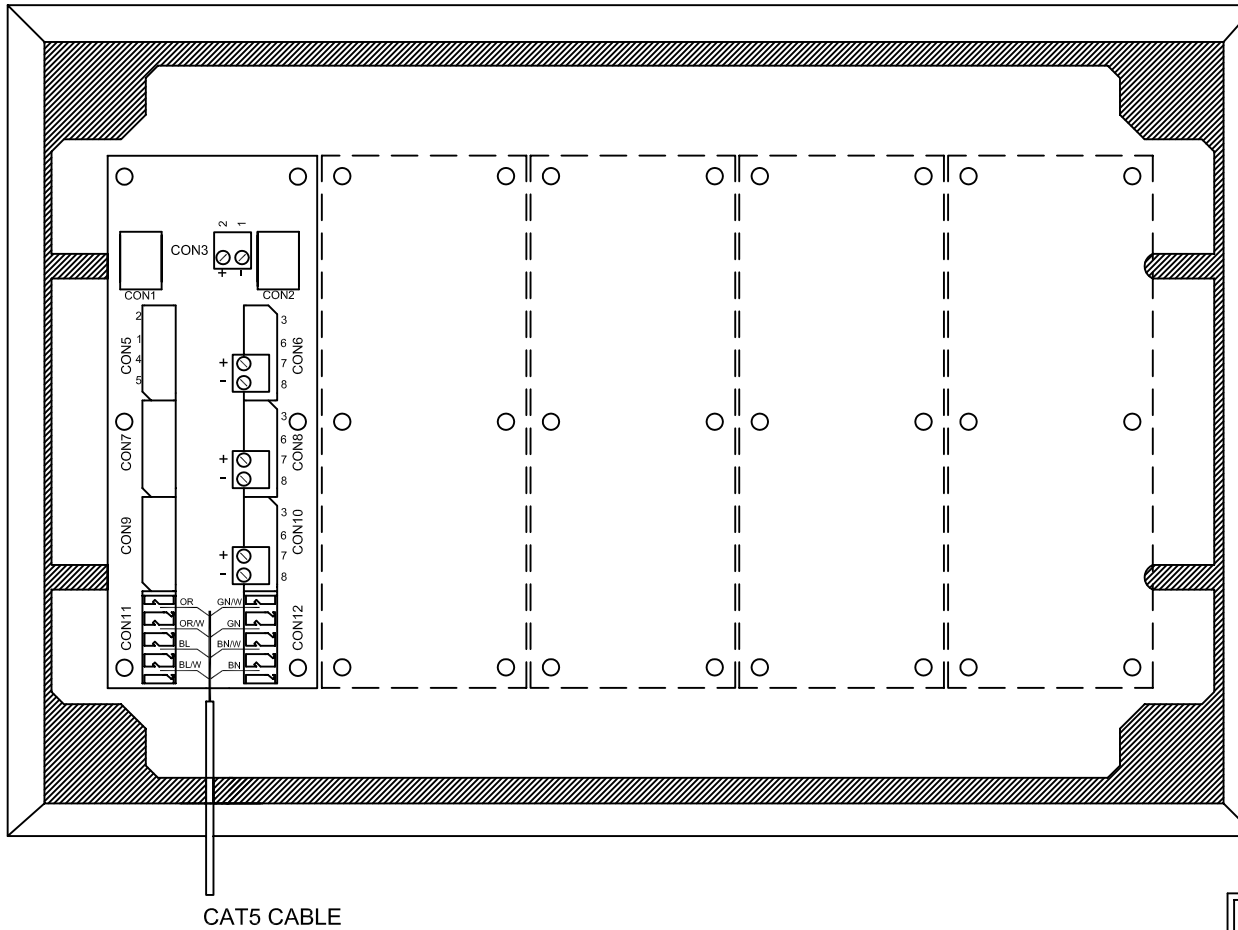

IMPORTANT NOTES:

1. Colour Scheme/pin numbering is according to TIA568B
2. CAT5 cable must be to CAT5 UTP spec or above.
3. Correct tool must be used for IDC connectors.
4. PCBs and mounting plate must be removed prior to drilling the box.

		JTL SYSTEMS LTD 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE: RG14 5SJ TEL: 01635 263646 FAX: 01635 263647		
		ISSUE	DESCRIPTION	APP'D
1	ORIGINAL ISSUE	MJK	01/12	
TITLE: LEGACY CABLE TO ZM15 5 ZONE CAT5 ZONE MARSHALLING CONNECTIONS				
PROJ.	DRG No: 03919	SHT 1	OF 1	ISS. 1

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP