


# PD110 PREDICT DEFROST INITIATOR



- NOTES:**
1. INPUTS ARE 230V ac  
CONNECT TERMINAL 14 TO CONTROL SUPPLY NEUTRAL.  
THIS UNIT IS NOT SUITABLE FOR 415V USE.  
INPUTS AND CONTROL SUPPLY MUST BE ON THE SAME PHASE.
  2. OUTPUTS ARE NOT INTERNALLY SUPPRESSED.

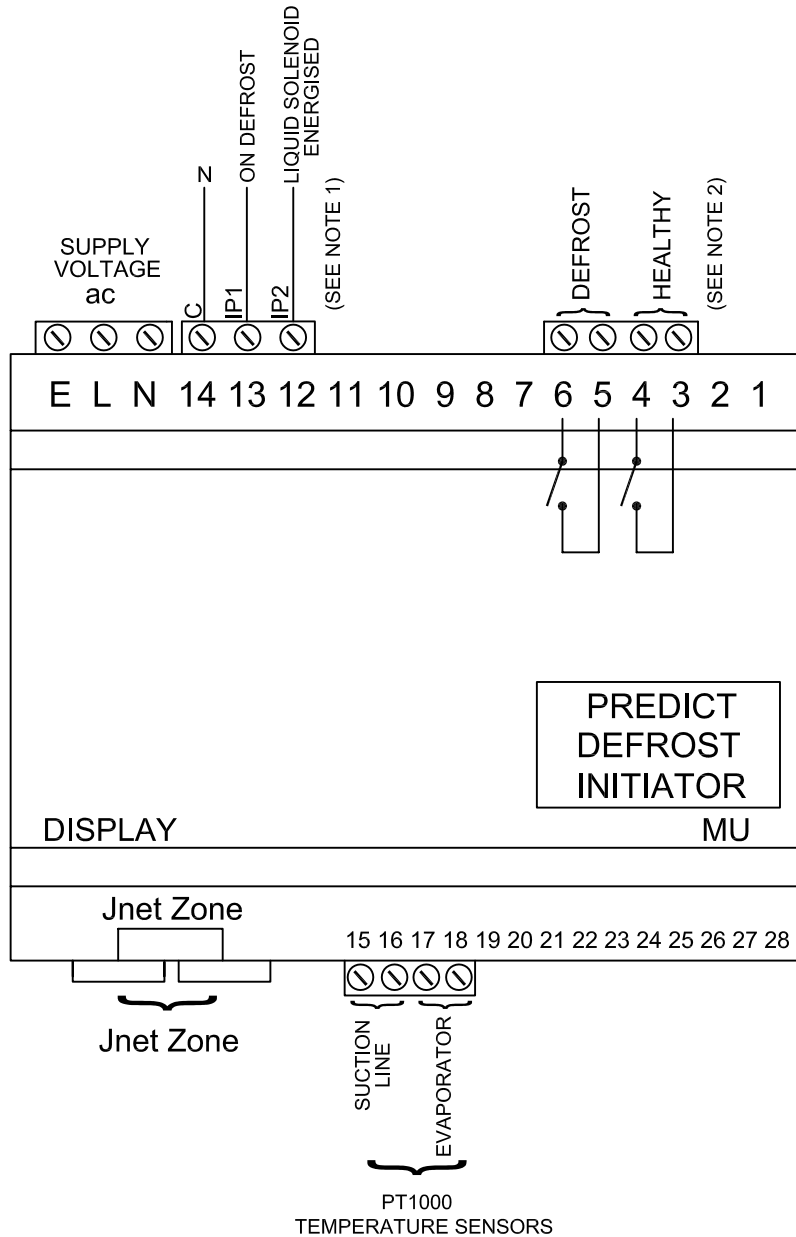

JTL SYSTEMS LTD  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	ADDED TO NOTE 1	MJK	03/13
2	ADDED NOTES 1 & 2	MJK	03/12
1	ORIGINAL ISSUE	MJK	02/12

TITLE:  
**PD110 PREDICT DEFROST INITIATOR**

PROJ.	DRG No: <b style="font-size: 1.2em;">03923</b>	SHT	OF	ISS.
		<b>1</b>	<b>1</b>	<b>3</b>