



CL110 & CL120 ENERGY MANAGEMENT UNIT

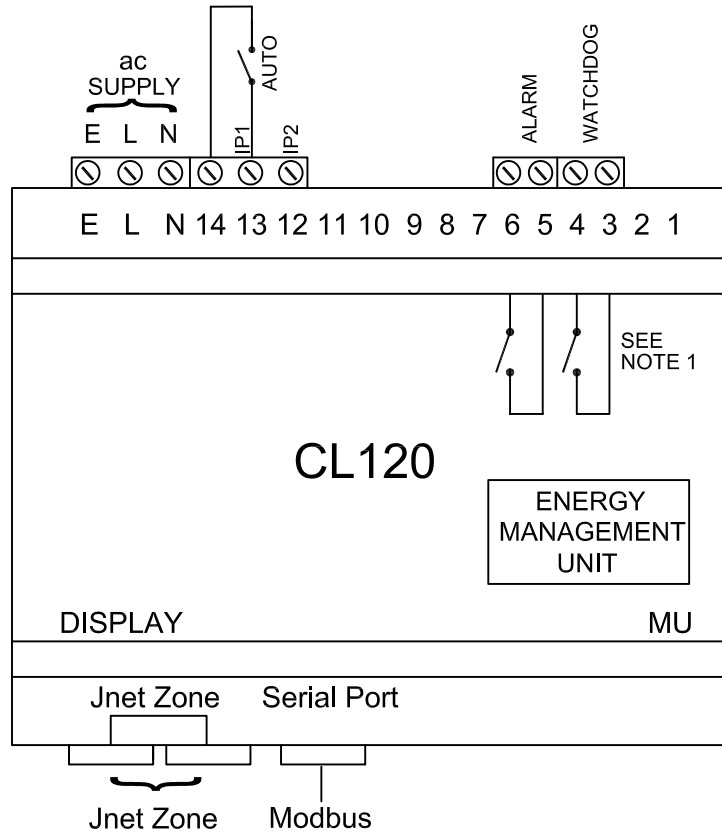

NOTE:

1. OUTPUTS ARE UNSUPPRESSED.
2. INPUT IS VOLT FREE EXCITATION 15 Vac (CL110) OR 12 Vdc (CL120).
3. IF REPLACING CL110 WITH CL120 INPUT COMMON MUST BE MOVED TO TERMINAL 14.

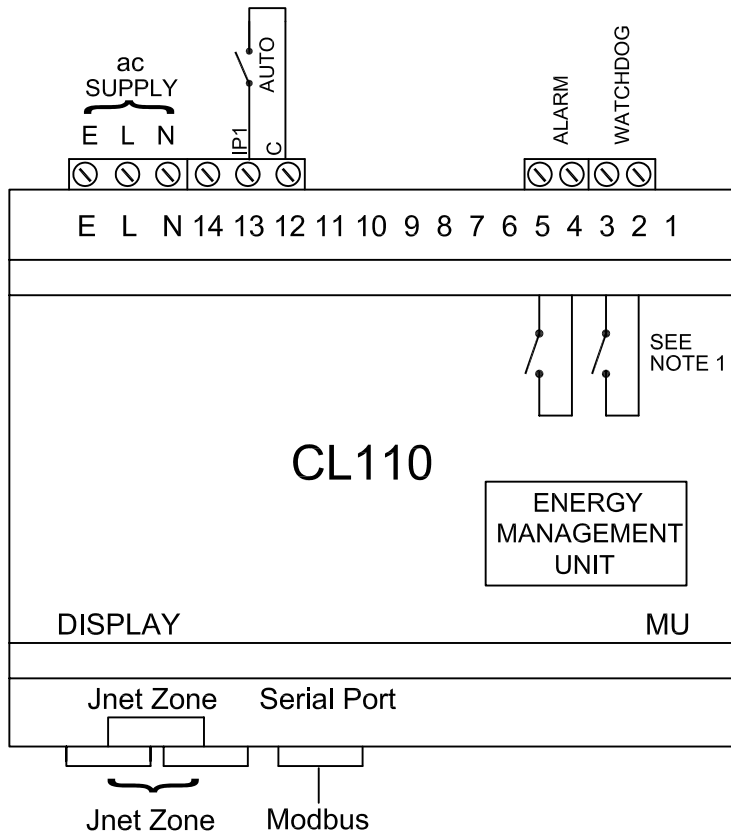

JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

| ISSUE | DESCRIPTION | APP'D | DATE |
|-------|---------------------------------|-------|-------|
| 3 | CL120 ADDED | MJK | 07/16 |
| 2 | CHANGED TITLE ADDED SERIAL PORT | MJK | 11/13 |
| 1 | ORIGINAL ISSUE | MJK | 10/13 |

TITLE:
**CL110 & CL120
 ENERGY MANAGEMENT UNIT**

| PROJ. | DRG No: | SHT | OF | ISS. |
|-------|---------|-----|----|------|
| | 04229 | 1 | 1 | 3 |