


# FL210 WATER RECLAIM CONTROLLER CONNECTIONS DRAWING

### Analogue Connections

INPUT		
AI1	TP501	Hot Water Temperature
AI2	TP501	Supply Water Temperature
AI3	TP501	Not used
AI4	TP501	Not used
AI5	TP501	Not used
AI6	TP501	Not used
AI7	TP501	Not used

### Digital Connections

OUTPUT		
DQ1	Unsuppressed	Watchdog
DQ2	Unsuppressed	Not used
INPUT		
DI1	Volt Free	Plant healthy
DI2	Volt Free	Flow pulse
DI3	Volt Free	Auto

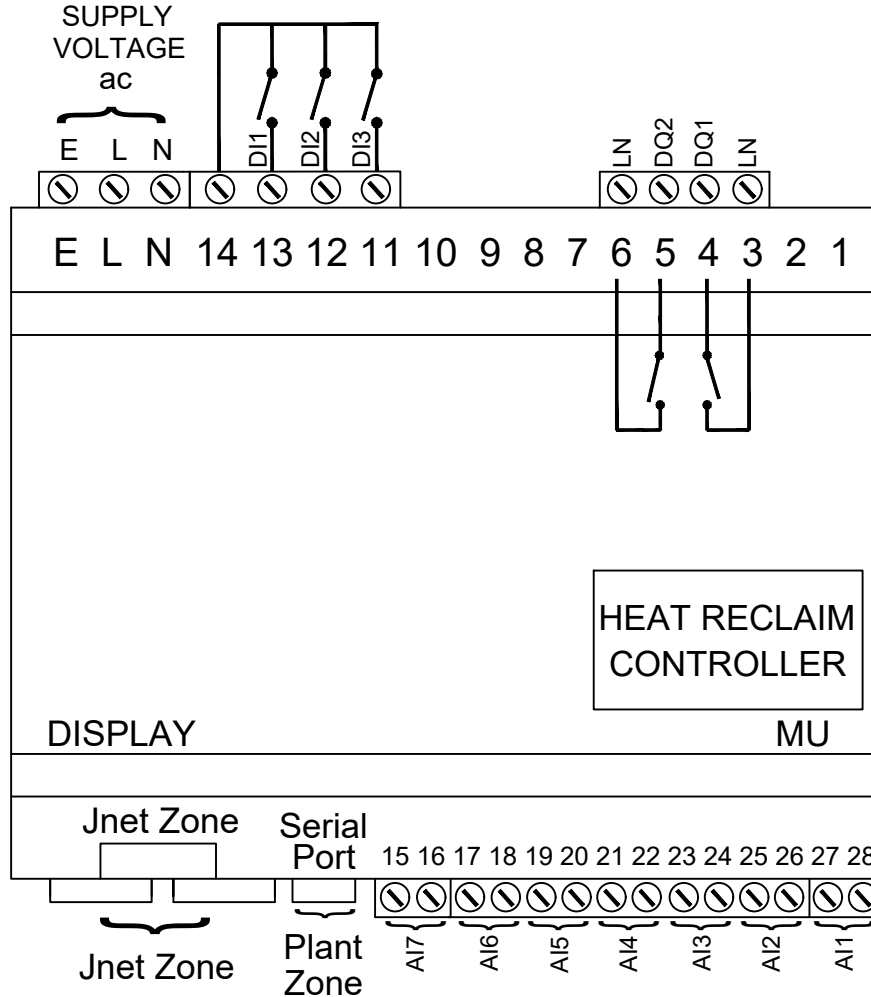

### NOTE

1. Connect line voltages to terminals prefixed LN and the corresponding loads to terminals prefixed DQ.



JTL SYSTEMS LTD  
41 KINGFISHER COURT, HAMBRIDGE RD,  
NEWBURY, BERKSHIRE: RG14 5SJ  
TEL: 01635 263646 FAX: 01635 263647

ISSUE	DESCRIPTION	APP'D	DATE
3	DIGITAL INPUTS AMENDED	MJK	06/18
2	WATER SENSORS SWAPPED	MJK	04/15
1	ORIGINAL ISSUE	MJK	02/15

TITLE:  
**FL210 WATER HEAT RECLAIM CONTROLLER  
CONNECTIONS DRAWING**

PROJ.	DRG No:	SHT	OF	ISS.
	<b>04427</b>	1	1	3