


- NOTES:
1. ZONES 1 TO 4 ARE FOR CONTROLLERS & MONITORS, THE PLANT ALARM ZONE IS FOR SIMPLE INTERFACE EQUIPMENT.
 2. ZONES 1 TO 4 CAN ACCOMODATE UP TO 31 UNITS, THE PLANT ALARM ZONE IS LIMITED TO A MAXIMUM OF 8 UNITS.
 3. SIMPLE PLUG IN JUMPER CABLES ARE AVAILABLE FOR CONNECTING DISPLAY CABINETS TOGETHER.
 4. FOR CONNECTIONS TO SITE PC SEE DRG 02717 FOR INSTALLATIONS UNTIL MAY 2001 OR DRG 02720 FOR INSTALLATIONS AFTER MAY 2001.

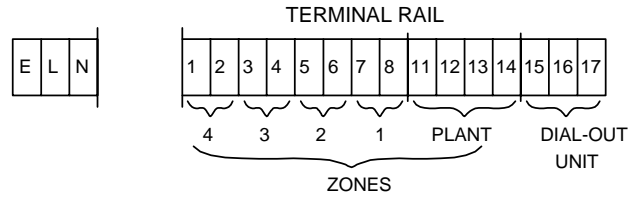

JTL SYSTEMS LTD.
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE. RG14 5SJ
 TEL: 01635-263646 FAX: 01635-263647

ISS	DESCRIPTION	APP'D	DATE
6	REMOVED LINE DRIVER CONNECTION. CHANGED NOTE 4	MJK	11/01
5	CHANGED PC - NETWORK CONTROLLER	MJK	5/01
4	UPDATED TEXT FOR ZONE 5	MJK	8/97

TITLE: COMMUNICATIONS UNIT EXTERNAL WIRING

TYPE: CU1, CU2 & CU4

PROJ.	DRG No:	SHT	OF	ISS
CC	00100	1	1	6

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP