


# UAPI & UAPJ DISPLAY CABINET CONTROLLER & ASSOCIATED PARTS SCHEMATIC

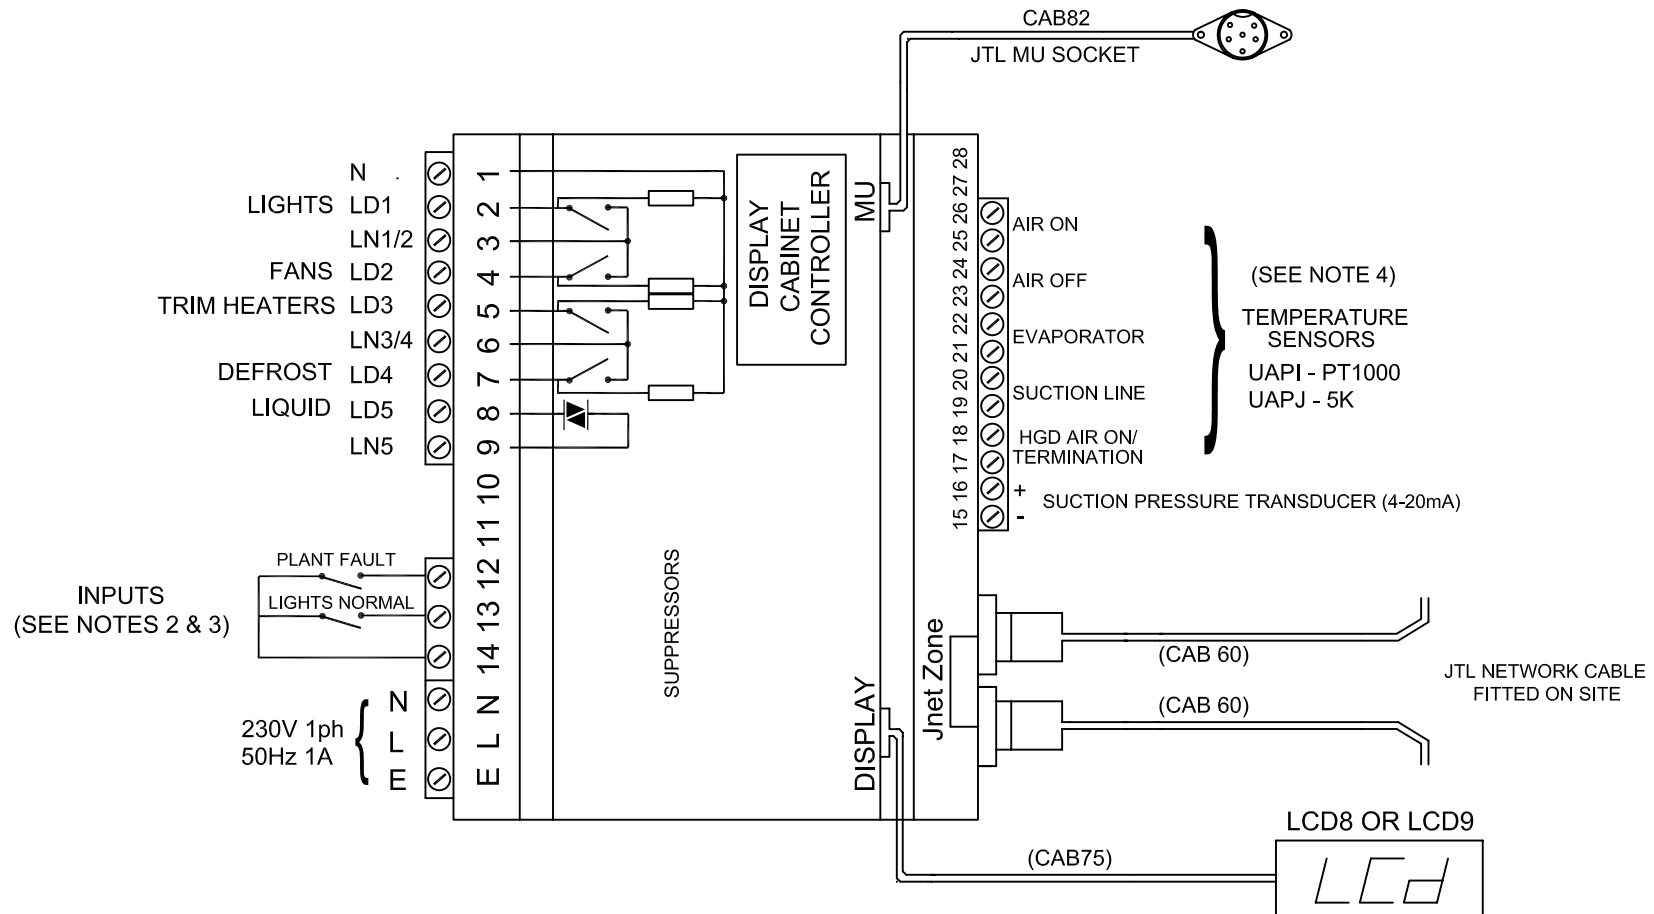

**NOTES:**

1. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
2. INPUTS ARE FOR VOLT FREE CONTACTS. CONTACTS ARE CLOSED FOR THE 'ON' CONDITION SHOWN.
3. LIGHTING NORMAL INPUT CONDITION DISCONTINUED FROM V0.00.3 FIRMWARE.
4. SELECTION OF TERMINATION SENSOR ALLOWED ON UAPJ AND FROM UAPI FIRMWARE VERSION 0.00.4

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

		<b>JTL SYSTEMS LTD.</b> 41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ TEL: 01635-263646 FAX: 01635-263647	
ISS	DESCRIPTION	APP'D	DATE
3	ADDED HGD AIR ON & NOTE 4	MJK	09/12
5	ADDED UAPJ	MJK	09/15
4	INPUTS UPDATED.	MJK	03/13
TITLE: <b>DISPLAY CABINET CONTROLLER &amp; ASSOCIATED PARTS SCHEMATIC</b>			
TYPE: <b>UAPI/UAPJ</b>			
PROJ.	DRG No:	SHT	OF
UA	03883	1	1
			ISS.
			5