


# UAPA DISPLAY CABINET CONTROLLER & ASSOCIATED PARTS SCHEMATIC

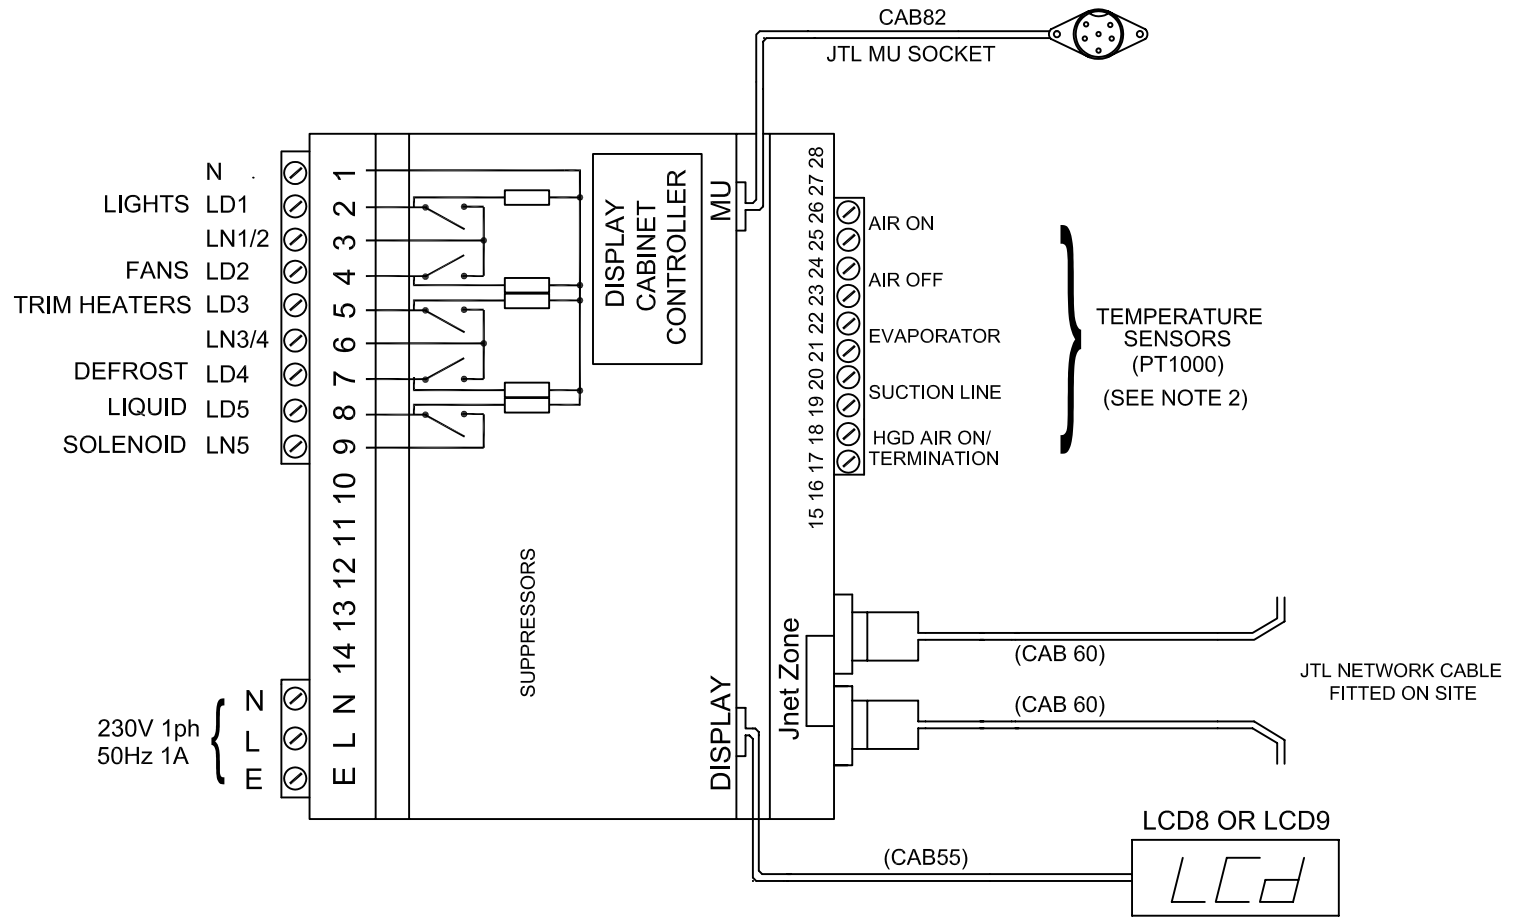

## NOTES

1. TO MEET EMC REQUIREMENTS THE CONTROLLER MUST BE INSTALLED ACCORDING TO THE INSTALLATION REQUIREMENTS SHEET FOR THIS PRODUCT.
2. SELECTION OF TERMINATION SENSOR ALLOWED FROM FIRMWARE VERSION 0.00.3

<b>JTL SYSTEMS LTD.</b>		41 KINGFISHER COURT, HAMBRIDGE RD, NEWBURY, BERKSHIRE. RG14 5SJ TEL: 01635-263646 FAX: 01635-263647	
ISS	DESCRIPTION	APP'D	DATE
2	ADDED HGD AIR ON & NOTE 2	MJK	09/12
1	ORIGINAL ISSUE	MJK	05/12
TITLE: DISPLAY CABINET CONTROLLER & ASSOCIATED PARTS SCHEMATIC			
TYPE: UAPA			
PROJ.	DRG No:	SHT	OF
UA	03999	1	1
			ISS.
			2

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP