


CU/CULG Replacement with NC610/NC620/NC630

- Cables required:
 CAB63-20 x 1**
 CAB65-05 x 5
 CAB72-05 x 1
 CAB73-06 x 1
 RJ11 Modem Cable x 1

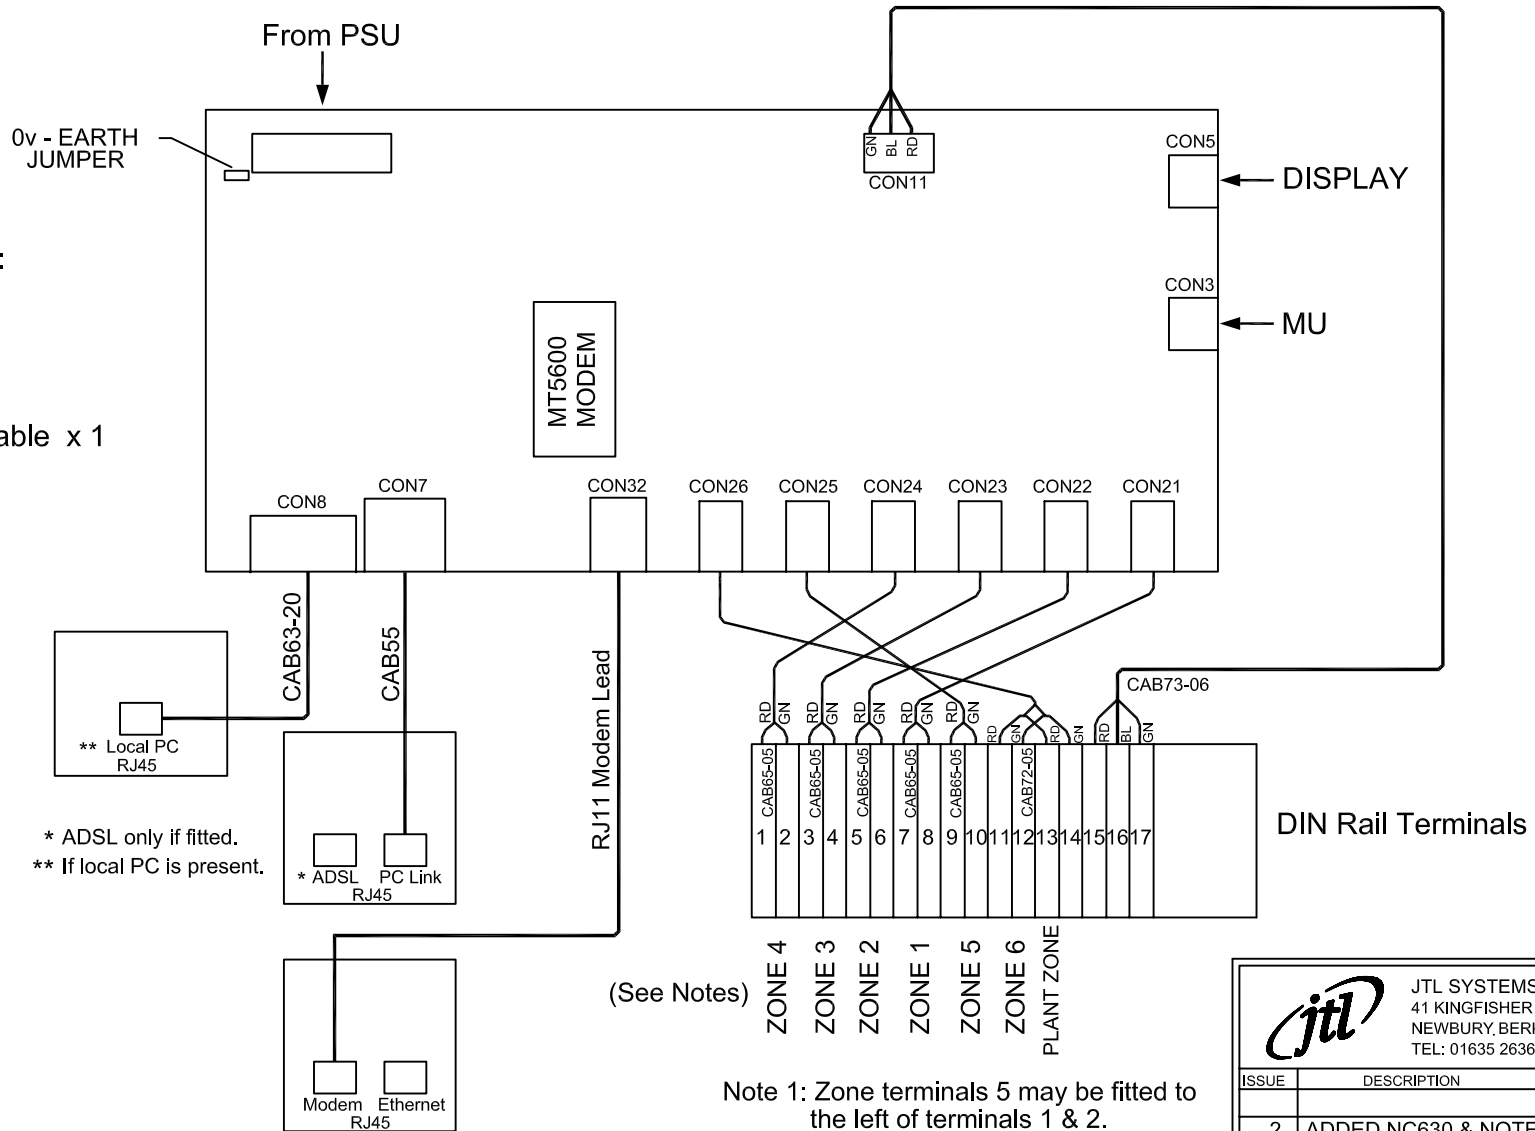

THIS IS AN UNCONTROLLED COPY - UNLESS STAMPED WITH CONTROLLED COPY STAMP

jtl JTL SYSTEMS LTD
 41 KINGFISHER COURT, HAMBRIDGE RD,
 NEWBURY, BERKSHIRE: RG14 5SJ
 TEL: 01635 263646 FAX: 01635 263647

| ISSUE | DESCRIPTION | APP'D | DATE |
|-------|---------------------|-------|-------|
| 2 | ADDED NC630 & NOTES | MJK | 12/08 |
| 1 | ORIGINAL ISSUE | MJK | 12/05 |

TITLE:
CU Replacement with NC6xx

| PROJ. | DRG No: | SHT | OF | ISS. |
|-------|---------|-----|----|------|
| | 03244 | 1 | 1 | 2 |